

CATALOG

CFR Series Fan-Powered, 50/60 Hz VAV Terminals



TABLE OF CONTENTS

Features and Benefits 2
 Construction Features 4
 Standard and Optional Features 6
 Application and Selection..... 7
 Primary Airflow Calibration..... 10
 Dimensional Data 11
 General Selection Data, 50 Hz PSC Motor 13
 Sound Power Data, 50 Hz PSC Motor..... 15
 Fan Performance, 50 Hz PSC Motor 17
 General Selection Data, 60 Hz PSC Motor 19
 Sound Power Data, 60 Hz PSC Motor..... 21
 Fan Performance, 60 Hz PSC Motor 23
 EC Fan Motor Option 25
 General Selection, EC Motor 26
 Fan Performance, EC Motor 27
 AHRI Ratings 28
 Electric Heat 29
 Hot Water Coil Data 30
 Guide Specifications..... 37

NOTES:

- All data herein is subject to change without notice. Some drawings are not shown in this catalog.
- Drawings not for installation purposes.
- Construction drawings and performance data contained herein should not be used for submittal purposes.
- ETL Report Number 476203.



FEATURES AND BENEFITS

QUIET, EFFICIENT COMFORT

Model CFR fan terminals are specifically designed for quiet operation. They also offer improved space comfort and flexibility for a wide variety of HVAC systems. This is critical in today’s buildings, where occupants are placing more emphasis on indoor acoustics.

OCCUPANT-SENSITIVE DESIGN

Due to heightened interest in Indoor Air Quality, many HVAC system designers are focusing on the effects of particulate contamination within a building’s occupied space. Often, HVAC system noise is overlooked as a source of occupied space contamination. The CFR terminal is specifically designed to eliminate obtrusive fan noise from reaching the occupants, while providing constant air motion in the space.

Occupants will benefit from the CFR design that minimizes low frequency (125Hz-250Hz) sound levels that typically dominate the space sound level. The CFR also minimizes the fluctuation in sound levels that occur during VAV damper modulation.

FLEXIBILITY

Selection and Layout. The CFR provides flexibility in system design. Reduced noise at the fan terminal allows the system designer to place properly sized units directly above occupied spaces. It is not necessary to use the crowded space above a hall or corridor to locate

the equipment. This will reduce lengthy and expensive discharge duct runs. The standard shallow casing height (14" up to 1000 CFM) minimizes conflict with other systems competing for ceiling space. The FlowStar™ sensor ensures accurate control, even when space constraints do not permit long straight inlet duct runs to the terminal.

Sizes. Model CFR terminals are available in nine fan sizes to handle airflow capacities between 100 and 4800 CFM. Most fan sizes are available with three primary air valve sizes to optimize the unit fan and primary air valve combinations required by current industry needs.

A web-based Computer Selection Program, “Web-Select”, is available to facilitate the selection process. Contact your representative to obtain access to this powerful and time-saving program.

CONVENIENCE

Quality. All CFR terminals are thoroughly inspected during each step of the manufacturing process, including a comprehensive “pre-ship” inspection, to assure the highest quality product available. Each unit is also “run tested” before leaving the factory to ensure trouble free field “start-up.”

Quick Installation. A standard single point electrical main power connection is provided. Electronic controls and electrical components are located on the same side of the casing for quick access, adjustment, and trouble-

FEATURES AND BENEFITS

shooting. Installation time is minimized with the availability of factory calibrated controls.

Finite fan speed adjustment is accomplished with an electronic SCR controller. The SCR fan speed controller is manufactured by ENVIRO-TEC and is compatible with the fan motor. This minimizes electronic interference and harmonic distortion that occurs from non-compatible motor and SCR components. Increased motor life and efficiency result from the compatible design.

CFR terminals utilize three tap motors that accommodate a broad range of flow and static pressure field conditions while dramatically increasing efficiency.

The FlowStar™ sensor ensures accurate airflow measurement, regardless of the field installation conditions. A calibration label and wiring diagram is located on the terminal for quick reference during start-up.

The terminal is constructed to allow installation with standard metal hanging straps. Optional hanger brackets for use with all-thread support rods or wire hangers are also available.

VALUE AND SECURITY

Quality. All metal components are fabricated from galvanized steel. Unlike most manufacturers' terminals, the steel used in the CFR is capable of withstanding a 125 hour salt spray test without showing any evidence of red rust.

Energy Efficiency. In addition to quiet and accurate temperature control, the building owner will benefit from lower operating costs. The highly amplified velocity pressure signal from the FlowStar™ inlet sensor allows precise airflow control at low air velocities.

The FlowStar™ sensor's airfoil shape provides minimal pressure drop across the terminal. This allows the central fan to run at a lower pressure and with less brake horsepower. Energy efficient three tap, three winding, permanent split capacitor fan motors are manufactured to ensure efficient, quiet, reliable, and low maintenance operation.

Three tap motors provide superior energy efficiency over single speed motors by delivering three separate horsepower outputs. For example, a nominal 1/2 HP

motor delivers 1/3 HP on medium tap and 1/4 HP on low tap. This allows the motor to operate at a higher efficiency when at a reduced fan capacity.

Fan terminals that utilize a single speed motor must rely solely on an SCR controller to obtain the reduction in fan capacity. At minimum turndown, they suffer from excessive power consumption and high motor winding temperatures, significantly reducing the motor life.

As an option, Model CFR is available with a "Gentec® Eon," "Electronically Commutated Motor," providing efficiency ratings between 70% and 80% for most applications.

Agency Certification. Model CFR terminals, including those with electric heat, are listed with ETL as an assembly, and bear the ETL label.

CFR terminals comply with applicable NEC requirements, are tested in accordance with AHRI Standard 880, and are certified by AHRI.

Maintenance and Service. CFR fan terminals require no periodic maintenance other than optional filter replacement. If component replacement becomes necessary, the unit is designed to minimize field labor. The bottom casing panels can be removed to provide easy access to the fan assembly, and the motor electrical leads are easily unplugged.

Controls. Model CFR terminals are available with analog electronic, consignment DDC, and pneumatic controls. ENVIRO-TEC manufactures a complete line of analog electronic controls specifically designed for use with CFR terminals. These controls are designed to accommodate a multitude of control schemes.


From the most basic to the most sophisticated sequence of operation, the controls are designed by experts in VAV terminal operation. Refer to the Electronic Controls Selection Guide, and the Pneumatic Controls Selection Guide for a complete description of the sequences and schematic drawings that are available.

Standard features include the patented FlowStar™ airflow sensor, ETL Listing, NEMA 1 enclosure, 24 volt control transformer, floating modulating actuator and balancing tees.

CONSTRUCTION FEATURES

MODEL CFR

The CFR terminal incorporates many unique features. Most of these **standard** features are expensive options for other manufacturers.

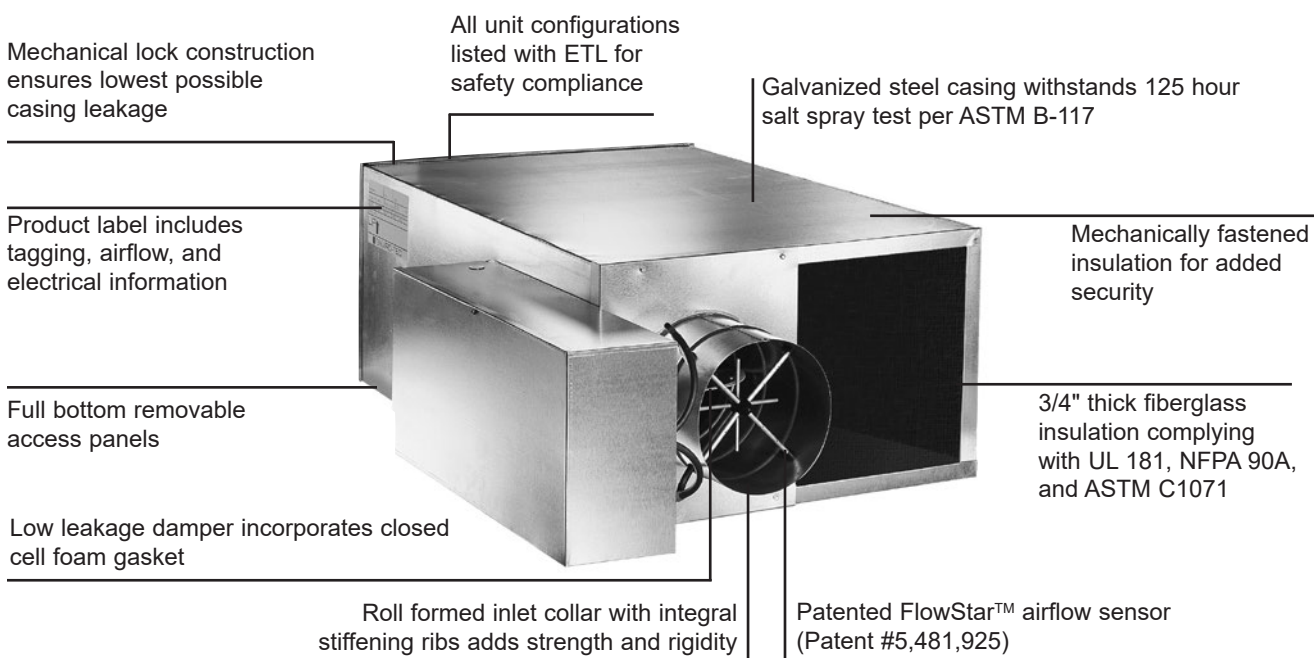

OPTIONAL CONSTRUCTION FEATURES

- "Genteq Eon," "Electronically Commutated Motor," fan motor
- Mounting brackets to accept all-thread hanging rods or wire hangers
- Double wall construction
- Scrim reinforced foil faced insulation meeting ASTM C1136 for mold, mildew, and humidity resistance
- Elastomeric closed cell foam insulation
- Filter located at induction inlet
- Hot water (CFR-WC), steam, or electric heating coils (CFR-EH) mounted at unit discharge. Access plate upstream of hydronic coil is standard.
- Low temperature construction for use in thermal storage applications. Includes thermally isolated primary air inlet and composite damper shaft.
- Factory control options: analog electronic, DDC electronic, pneumatic
- Factory piping packages
- Induction inlet gravity damper reduces radiated NC level by up to 2 NC at full cooling condition.

CONSTRUCTION FEATURES

ACCURATE AND ENERGY-SAVING AIRFLOW CONTROL WITH THE PATENTED FLOWSTAR™ SENSOR

Many VAV terminals waste energy due to an inferior airflow sensor design that requires the minimum CFM setpoint to be much higher than the IAQ calculation requirement. This is common with interior spaces that will be effected year round. These interior VAV terminals waste energy in several ways. First, the primary air fan (e.g. AHU) supplies more CFM than the building requires. The higher minimum CFM setpoint overcools the zone with VAV terminals without integral heat. To maintain thermal comfort a building engineer would need to change the minimum setpoint to zero CFM compromising indoor air quality. Interior VAV terminals with integral heat provide adequate comfort in the space but waste significant energy as energy is consumed to mechanically cool the primary air only to have more energy consumed to heat the cooled primary air. Significant energy savings is obtained with proper sizing and by making sure approved VAV terminals are capable of controlling at low CFM setpoints, providing the minimum ventilation requirement.

Currently, most DDC controllers have a minimum differential pressure limitation between 0.015" and 0.05" w.g. The major DDC manufacturers can control down to 0.015" w.g. An airflow sensor that does not amplify, e.g., a Pitot tube, requires about 490 FPM to develop 0.015" w.g. differential pressure. The FlowStar™ develops 0.015" w.g. pressure with only 290 FPM on a size 6 terminal and less than 325 FPM for a size 16. Consequently, VAV terminals utilizing a non-amplifying type sensor could have minimum CFM's that are well over 50% higher than an ENVIRO-TEC terminal. Many airflow sensors provide some degree of amplification simply due to the decrease in free area of the inlet from large area of the sensor. These VAV terminals still require minimum CFM's up to 30% higher than an ENVIRO-TEC terminal, have higher sound levels, and higher pressure drop requiring additional energy consumption at the primary air fan.

A VAV system designed with ENVIRO-TEC terminals consumes significantly less energy than a comparable system with competitor's terminals. The FlowStar™

airflow sensor reduces energy consumption by allowing lower zone minimum CFM setpoints, greatly reducing or eliminating "reheat", and by imposing less resistance on the primary air fan.


The ENVIRO-TEC air valve features the FlowStar™ airflow sensor which has brought new meaning to airflow control accuracy. The multi-axis design utilizes between 12 and 20 sensing points that sample total pressure at center points within equal concentric cross-sectional areas, effectively traversing the air stream in two planes. Each distinct pressure reading is averaged within the center chamber before exiting the sensor to the controlling device.

This sensor adds a new dimension to signal amplification. Most differential pressure sensors provide a signal between .5 and 2 times the equivalent velocity pressure signal. The FlowStar™ provides a differential pressure signal that is 2.5 to 3 times the equivalent velocity pressure signal. This amplified signal allows more accurate and stable airflow control at low airflow capacities. Low airflow control is critical for indoor air quality, reheat minimization, and preventing over cooling during light loads.

Unlike other sensors which use a large probe surface area to achieve signal amplification, the FlowStar™ utilizes an unprecedented streamline design which generates amplified signals unrivaled in the industry. The streamlined design also generates less pressure drop and noise.

The VAV schedule should specify the minimum and maximum airflow setpoints, maximum sound power levels, and maximum air pressure loss for each terminal. The specification for the VAV terminal must detail the required performance of the airflow sensor. For maximum building occupant satisfaction, the VAV system designer should specify the airflow sensor as suggested in the Guide Specifications of this catalog.

FlowStar™ Airflow Sensor Patent #5,481,925

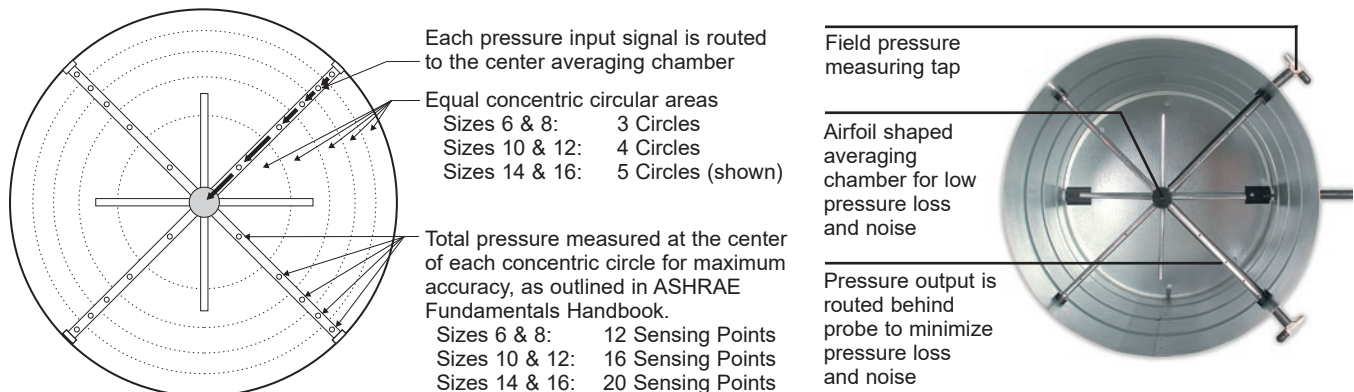

STANDARD AND OPTIONAL FEATURES

STANDARD FEATURES

Construction

- AHRI 880 certified and labeled
- 22 gauge galvanized steel casing and valve
- 3/4" thick fiberglass insulation
- Large access openings allowing removal of complete fan assembly for all heating coil options

Fan Assembly

- Forward curved, dynamically balanced, direct drive, galvanized fan wheel
- 115 or 277 volt single phase, three tap PSC motor
- SCR fan speed controller
- Quick-select motor speed terminal
- Permanently lubricated motor bearings
- Thermally protected motor
- Vibration isolation motor mounts
- Single point wiring

Primary Air Valve

- Embossed rigidity rings
- Low thermal conductance damper shaft
- Position indicator on end of damper shaft
- Mechanical stops for open and closed position
- FlowStar™ center averaging airflow sensor
- Balancing tees

Hot Water Coils

- Coils are designed, manufactured, and tested by ENVIRO-TEC
- AHRI 410 certified and labeled
- 1, 2, 3, 4 row coils
- Tested at a minimum of 450 PSIG under water and rated at 300 PSIG working pressure at 200°F
- Left or right hand connections

Electrical

- cETL listed for safety compliance
- NEMA 1 wiring enclosure

Electric Heat

- ETL listed as an assembly for safety compliance per UL 1995
- Integral electric heat assembly
- Automatic reset primary and back-up secondary thermal limits
- Single point power connection
- Hinged electrical enclosure door
- Fusing per NEC

OPTIONAL FEATURES

Construction

- 20 gauge galvanized steel construction
- 1" insulation
- Foil faced scrim backed insulation
- 1/2" thick elastomeric closed cell foam insulation
- Double wall construction with 22 gauge liner
- 1" throwaway filter

Fan Assembly

- 208-230 volt PSC motor
- 220-240 volt 50 Hz motor
- 120, 208, 240 and 277 volt ECM motors

Electrical

- Full unit toggle disconnect
- Inline motor fusing
- Primary and secondary transformer fusing

Electric Heat

- Proportional (SSR) heater control
- Magnetic contactors
- Door interlocking disconnect switches

Controls

- Factory provided controls include:
 - Analog electronic
 - Pneumatic
- Consignment DDC controls (factory mount and wire controls provided by others)

Piping Packages

- Factory assembled – shipped loose for field installation
- 1/2" and 3/4", 2 way, normally closed, two position electric motorized valves
- Isolation ball valves with memory stop
- Fixed and adjustable flow control devices
- Unions and P/T ports
- Floating point modulating control valves
- High pressure close-off actuators (1/2" = 50 PSIG; 3/4" = 25 PSIG)

APPLICATION AND SELECTION

PURPOSE OF SERIES FLOW FAN TERMINALS

Series flow fan powered terminals offer improved space comfort and flexibility in a wide variety of applications. Substantial operating savings can be realized through the recovery of waste heat, reduced central fan horsepower requirements and night setback operation.

Heat Recovery. The CFR recovers heat from lights and core areas to offset heating loads in perimeter zones. Additional heat is available at the terminal unit using electric, steam, or hot water heating coils. Controls are available to energize remote heating devices such as wall fin, fan coils, radiant panels, and roof load plenum unit heaters.

IAQ. The CFR enhances the indoor air quality of a building by providing constant air motion, and higher air volumes in the heating mode than typically provided by straight VAV single duct terminals or parallel flow fan terminals. The higher air capacity provides continuous air motion in the space and lowers the heating discharge air temperature. This combination improves air circulation, preventing accumulation of CO² concentrations in stagnant areas. Increased air motion improves occupant comfort. The higher air capacity also improves the performance of diffusers and minimizes diffuser “dumping”.

ACOUSTICAL CONCEPTS

The focus on indoor air quality is also having an effect on proper selection of air terminal equipment with respect to acoustics.

Sound. At the zone level, the terminal unit generates acoustical energy that can enter the zone along two primary paths. First, sound from the unit fan can propagate through the downstream duct and diffusers before entering the zone (referred to as Discharge or Airborne Sound). Acoustical energy is also radiated from the terminal casing and travels through the ceiling cavity and ceiling system before entering the zone (referred to as Radiated Sound).

To properly quantify the amount of acoustical energy emanating from a terminal unit at a specific operating condition (i.e. CFM and static pressure), manufacturers must measure and publish sound power levels.

The units of measurement, decibels, actually represent units of power (watts). The terminal equipment sound power ratings provide a consistent measure of the generated sound independent of the environment in which the unit is installed. This allows a straight forward comparison of sound performance between equipment manufacturers and unit models.

Noise Criteria (NC). The bottom line acoustical criteria for most projects is the NC (Noise Criteria) level. This NC level is derived from resulting sound pressure levels in the zone. These sound pressure levels are the effect of acoustical energy (sound *power* levels) entering the zone caused by the terminal unit and other sound generating sources (central fan system, office equipment, outdoor environment, etc.).

The units of measurement is once again decibels; however, in this case decibels represent units of pressure (Pascals), since the human ear and microphones react to pressure variations.

There is no direct relationship between sound power levels and sound pressure levels. Therefore, we must predict the resulting sound pressure levels (NC levels) in the zone based in part by the published sound power levels of the terminal equipment. The NC levels are totally dependent on the project specific design, architecturally and mechanically. For a constant operating condition (fixed sound power levels), the resulting NC level in the zone will vary from one project to another.

AHRI 885. A useful tool to aid in predicting space sound pressure levels is an application standard referred to as AHRI Standard 885. This standard provides information (tables, formulas, etc.) required to calculate the attenuation of the ductwork, ceiling cavity, ceiling system, and conditioned space below a terminal unit. These attenuation values are referred to as the “transfer function” since they are used to transfer from the manufacturer’s sound power levels to the estimated sound pressure levels resulting in the space below, and/or served by the terminal unit. The standard does not provide all of the necessary information to accommodate every conceivable design; however, it does provide enough information to approximate the transfer function for most applications. Furthermore, an Appendix is provided that contains typical attenuation values. Some manufacturers utilize different assumptions with respect to a “typical” project design; therefore, cataloged NC levels should not be used to compare acoustical performance. Only certified sound power levels should be used for this purpose.

GENERAL DESIGN RECOMMENDATIONS FOR A QUIET SYSTEM

The AHU. Sound levels in the zone are frequently impacted by central fan discharge noise that either breaks out (radiates) from the ductwork or travels through the distribution ductwork and enters the zone as airborne (discharge) sound. Achieving acceptable sound levels in the zone begins with a properly designed central fan system which delivers relatively quiet air to each zone.

APPLICATION AND SELECTION

Supply Duct Pressure. One primary factor contributing to noisy systems is high static pressure in the primary air duct. This condition causes higher sound levels from the central fan and also higher sound levels from the terminal unit, as the primary air valve closes to reduce the pressure. This condition is compounded when flexible duct is utilized at the terminal inlet, which allows the central fan noise and air valve noise to break out into the ceiling cavity and then enter the zone located below the terminal. Ideally, the system static pressure should be reduced to the point where the terminal unit installed on the duct run associated with the highest pressure drop has the minimum required inlet pressure to deliver the design airflow to the zone. Many of today's HVAC systems experience 0.5" w.g. pressure drop or less in the main trunk. For systems that will have substantially higher pressure variances from one zone to another, special attention should be paid to the proper selection of air terminal equipment.

To date, the most common approach has been to select (size) all of the terminals based on the worst case (highest inlet static pressure) condition. Typically, this results in 80% (or higher) of the terminal units being oversized for their application. This in turn results in much higher equipment costs, but more importantly, drastically reduced operating efficiency of each unit. This consequently decreases the ability to provide comfort control in the zone. In addition, the oversized terminals cannot adequately control the minimum ventilation capacity required in the heating mode.

A more prudent approach is to utilize a pressure reducing device upstream of the terminal unit on those few zones closest to the central fan. This device could simply be a manual quadrant type damper if located well upstream of the terminal inlet. In tight quarters, perforated metal can be utilized as a quiet means of reducing system pressure. This approach allows all of the terminal units to experience a similar (lower) inlet pressure. They can be selected in a consistent manner at lower inlet pressure conditions that will allow more optimally sized units.

Inlet duct that is the same size as the inlet collar and as straight as possible will achieve the best acoustical performance. For critical applications, flexible duct should not be utilized at the terminal inlet.


Zoning. On projects where internal lining of the downstream duct is not permitted, special considerations should be made to assure acceptable noise levels will be obtained. In these cases, a greater number of smaller zones will help in reducing sound levels. Where

possible, the first diffuser takeoff should be located after an elbow or tee and a greater number of small necked diffusers should be utilized, rather than fewer large necked diffusers.

The downstream ductwork should be carefully designed and installed to avoid noise regeneration. Bull head tee arrangements should be located sufficiently downstream of the terminal discharge to provide an established flow pattern downstream of the fan. Place diffusers downstream of the terminal after the airflow has completely developed.

Downstream splitter dampers can cause noise problems if placed too close to the terminal, or when excessive air velocities exist. If tee arrangements are employed, volume dampers should be used in each branch of the tee, and balancing dampers should be provided at each diffuser tap. This arrangement provides maximum flexibility in quiet balancing of the system. Casing radiated sound usually dictates the overall room sound levels directly below the terminal. Because of this, special consideration should be given to the location of these terminals as well as to the size of the zone. Larger zones should have the terminal located over a corridor or open plan office space and not over a small confined private office. Fan powered terminals should never be installed over small occupied spaces where the wall partitions extend from slab-to-slab (i.e. fire walls or privacy walls).

Fan Terminal Isolation. Model CFR fan terminals are equipped with sufficient internal vibration dampening means to prevent the need for additional external isolation. Flexible duct connectors at the unit discharge typically do more harm than good. The sagging membrane causes higher air velocities and turbulence, which translates into noise. Furthermore, the discharge noise breaks out of this fitting more than with a hard sheet metal fitting.

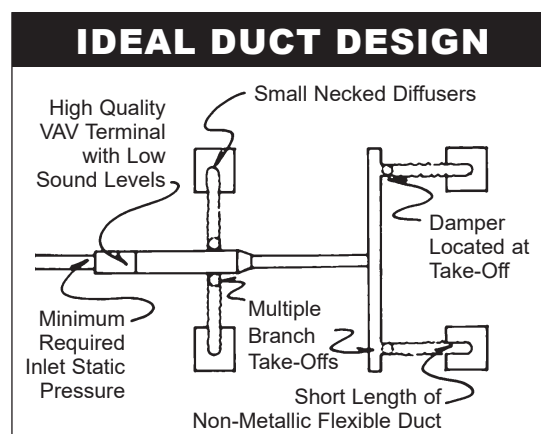

APPLICATION AND SELECTION

SELECTION GUIDELINES

The CFR fan terminal has been designed to provide maximum flexibility in matching primary air valve capacities (cooling loads) with unit fan capacities. The overall unit size is dictated by the fan size. With each unit fan size, multiple primary air valve sizes are available to handle a wide range of cooling capacities.

The fan should be sized first to determine the unit size. The selection is made by cross plotting the specified fan capacity and external static pressure on the appropriate fan performance curves (see page 17). Terminals utilizing hot water heating coils require the summation of the coil air pressure drop and the design E.S.P. to determine the total E.S.P. It is common to have more than one fan size which can meet the design requirements. Typically, the selection begins with the smallest fan that can meet the capacity. Occasionally this selection may not meet the acoustical requirements and thus the next larger fan size should be selected. "Upsizing" may also occur when it is necessary to meet the design capacity on the medium or low motor tap.

Fan selections can be made anywhere in the non-shaded areas. Each fan performance curve depicts the actual performance of the relative motor tap without additional fan balance adjustment. Actual specified capacities which fall below a particular fan curve (low, medium or high) is obtained by adjustment of the electronic (SCR) fan speed controller. After the proper fan is selected, the unit size is fixed and then the appropriate primary air valve is selected. Most of the unit fan sizes have three air valve sizes to select from. The middle size will typically be utilized. It is the size that is matched with the unit fan to deliver 100% cooling capacity for the majority of fan selections.

The larger primary air valve will be used in applications where the system fan is undersized, requiring a larger air valve to take advantage of lower pressure losses. While helping in this fashion, a penalty is paid by having a higher controllable minimum airflow setpoint than could be achieved with a smaller inlet size.

The smaller primary air valve will most often be utilized with thermal storage systems where lower than normal primary air temperatures are utilized. In these cases, the maximum design primary airflow is less than the fan capacity (typically 60 to 80%), and therefore a smaller air valve may be appropriate.

SYSTEM PRESSURE CONSIDERATIONS

Since the terminal unit fan is selected to move 100% of the design airflow to the zone, all downstream pressure losses are neglected when determining minimum primary air inlet pressure to the unit. The central fan is only required to overcome the minimal loss through the unit air valve, reducing the central fan total pressure and horsepower requirements. Due to extremely low pressure drop of the air valve, central fan operating inlet static pressures may be as low as 0.5" w.g.

COMMON MISAPPLICATION

It should be noted that a conventional Series Flow Fan Terminal cannot be applied as a booster fan. In problem areas where there is insufficient primary airflow capacity, this terminal will not aid in pulling more air from the primary duct. Instead the unit fan will draw air from the plenum inlet which has less resistance.


The induction opening should never be sealed, as this will cause problems should the primary airflow increase beyond the unit fan capacity. In this condition, the fan casing becomes pressurized which will eventually stall the fan motor and cause premature failure.

A web-based Computer Selection Program, "Web-Select", is available to facilitate the selection process. Contact your representative to obtain access to this powerful and time-saving program.

PRIMARY AIRFLOW CALIBRATION

FLOWSTAR™ CALIBRATION CHART

(For dead-end differential pressure transducers)

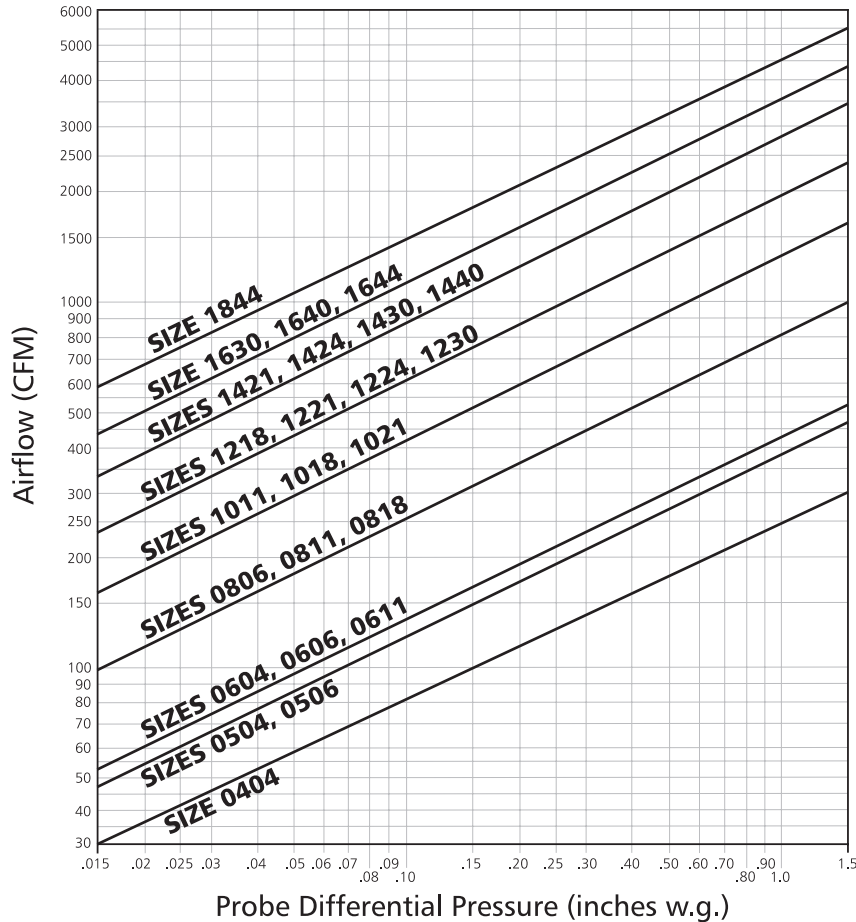

NOTE: Maximum and minimum CFM limits are dependent on the type of controls that are utilized. Refer to the table below for specific values. When DDC controls are furnished by others, the CFM limits are dependent on the specific control vendor that is employed. After obtaining the differential pressure range from the control vendor, the maximum and minimum CFM limits can be obtained from the chart above (many controllers are capable of controlling minimum setpoint down to .015" w.g.).

AIRFLOW RANGES (CFM)

UNIT SIZE	400 SERIES (PNEUMATIC) STANDARD CONTROLLER		7000 SERIES ANALOG ELECTRONIC		DDC CONSIGNMENT CONTROLS (See Notes Below)				
	MIN.	MAX.	MIN.	MAX.	MIN.			MAX.	
					Min. transducer differential pressure (in. w.g.)			Max. transducer differential pressure (in. w.g.)	
					.015	.03	.05	1.0	≥ 1.5
0404	43	250	35	250	30	43	55	250	250
0504, 0506	68	350	50	350	48	68	88	350	350
0604, 0606, 0611	75	490	60	550	53	75	97	435	530
0806, 0811, 0818	145	960	115	1000	105	145	190	840	1000
1011, 1018, 1021	235	1545	185	1600	165	235	305	1355	1600
1218, 1221, 1224, 1230	340	2250	285	2300	240	340	440	1975	2300
1421, 1424, 1430	475	3100	390	3100	335	475	615	2750	3100
1630, 1640, 1644	625	4100	520	4100	440	625	805	3595	4100
1844	810	4600	640	4600	580	810	1040	4470	4600

¹ Minimum and maximum airflow limits are dependent on the specific DDC controller supplied. Contact the control vendor to obtain the minimum and maximum differential pressure limits (inches W.G.) of the transducer utilized with the DDC controller.

² Maximum CFM is limited to value shown in General Selection Data.

DIMENSIONAL DATA


MODEL CFR

Drawings are not to scale and not for submittal or installation purposes.


UNIT SIZE	I	A	B	C	D	X	Y	W	H	L
0404	3 7/8 [98]	6 [152]	5 [127]	3/4 [19]	10 1/2 [267]	8 3/8 [213]	8 [203]	18 [457]	12 [305]	28 [711]
0504	4 7/8 [124]	6 [152]	5 [127]	3/4 [19]	10 1/2 [267]	8 3/8 [213]	8 [203]	18 [457]	12 [305]	28 [711]
0604	5 7/8 [149]	6 [152]	5 [127]	3/4 [19]	6 1/2 [165]	8 3/8 [213]	8 [203]	18 [457]	12 [305]	28 [711]
0506	4 7/8 [124]	6 [152]	3 1/8 [79]	3/4 [19]	10 1/2 [267]	11 [279]	8 [203]	23 3/8 [594]	14 [356]	35 [889]
0606	5 7/8 [149]	6 [152]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	11 [279]	8 [203]	23 3/8 [594]	14 [356]	35 [889]
0806	7 7/8 [251]	6 [152]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	11 [279]	8 [203]	23 3/8 [594]	14 [356]	35 [889]
0611	5 7/8 [149]	6 [152]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	11 [279]	8 [203]	23 3/8 [594]	14 [356]	35 [889]
0811	7 7/8 [200]	6 [152]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	11 [279]	8 [203]	23 3/8 [594]	14 [356]	35 [889]
1011	9 7/8 [251]	7 [178]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	11 [279]	8 [203]	23 3/8 [594]	14 [356]	35 [889]
0818	7 7/8 [200]	8 [203]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	15 [381]	8 [203]	29 3/8 [746]	17 [432]	40 [1016]
1018	9 7/8 [251]	8 [203]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	15 [381]	8 [203]	29 3/8 [746]	17 [432]	40 [1016]
1218	11 7/8 [302]	8 [203]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	15 [381]	8 [203]	29 3/8 [746]	17 [432]	40 [1016]
1021	9 7/8 [251]	8 [203]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	15 [381]	8 [203]	29 3/8 [746]	17 [432]	40 [1016]
1221	11 7/8 [302]	8 [203]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	15 [381]	8 [203]	29 3/8 [746]	17 [432]	40 [1016]
1421	13 7/8 [352]	9 [229]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	15 [381]	8 [203]	29 3/8 [746]	17 [432]	40 [1016]
1224	11 7/8 [302]	10 [254]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	28 [711]	11 [279]	38 [965]	19 [483]	54 [1372]
1424	13 7/8 [352]	10 [254]	3 1/8 [79]	3/4 [19]	6 1/2 [165]	28 [711]	11 [279]	38 [965]	19 [483]	54 [1372]
1230	11 7/8 [302]	10 [254]	9 7/8 [251]	1 1/4 [32]	6 1/2 [165]	40 [1016]	15 [381]	52 [1321]	19 [483]	62 [1575]
1430	13 7/8 [352]	11 1/2 [292]	9 7/8 [251]	1 1/4 [32]	6 1/2 [165]	40 [1016]	15 [381]	52 [1321]	19 [483]	62 [1575]
1630	15 7/8 [403]	11 1/2 [292]	9 7/8 [251]	1 1/4 [32]	6 1/2 [165]	40 [1016]	15 [381]	52 [1321]	19 [483]	62 [1575]
1440	13 7/8 [352]	11 1/2 [292]	9 7/8 [251]	1 1/4 [32]	6 1/2 [165]	40 [1016]	15 [381]	52 [1321]	19 [483]	62 [1575]
1640	15 7/8 [403]	11 1/2 [292]	9 7/8 [251]	1 1/4 [32]	6 1/2 [165]	40 [1016]	15 [381]	52 [1321]	19 [483]	62 [1575]
1644	15 7/8 [403]	11 1/2 [292]	9 7/8 [251]	3 1/4 [83]	6 1/2 [165]	40 [1016]	15 [381]	52 [1321]	19 [483]	62 [1575]
1844	15 7/8 [403] x 15 7/8 [403]	11 1/2 [292]	9 7/8 [251]	3 1/4 [83]	6 1/2 [165]	40 [1016]	15 [381]	52 [1321]	19 [483]	62 [1575]

NOTE: All dimensions are in inches [mm].


Left Side View
(Control Enclosure and Filter Rack Not Shown in This View)

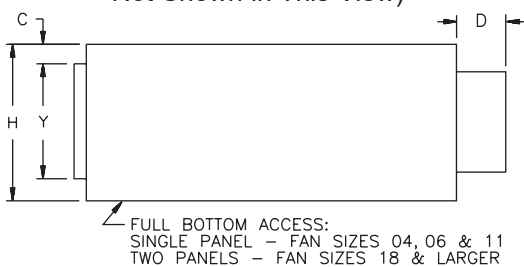

Top View
(Pneumatic Controls Not Shown in This View)

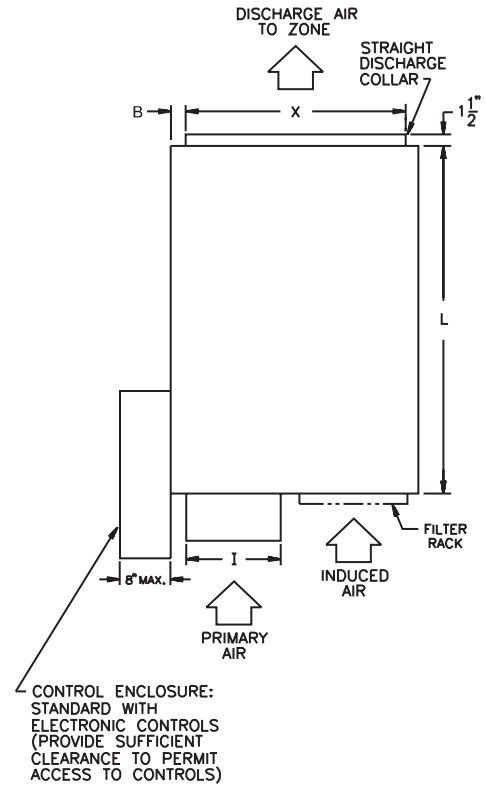

Inlet End View
(Electronic Controls and Filter Rack Not Shown in This View)

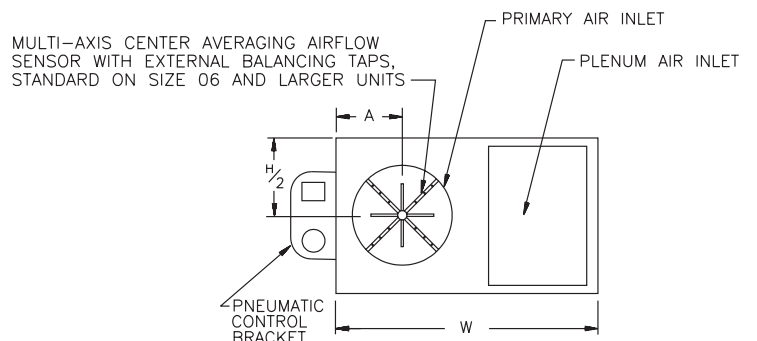


DIMENSIONAL DATA

MODEL CFR-WC HOT WATER COIL DETAIL

Drawings are not to scale and not for submittal or installation purposes.


FAN SIZE	G	J	K	M
04	10 [254]	12 [305]	10 [254]	3 [76]
06, 11	10 [254]	16 [406]	12 1/2 [318]	3 [76]
18, 21	10 [254]	22 [559]	12 1/2 [318]	3 [76]
24	10 [254]	28 [711]	17 1/2 [445]	3 [76]
30, 40	6 [152]	40 [1016]	17 1/2 [445]	9 3/4 [248]
44	6 [152]	44 [1118]	17 1/2 [445]	5 3/4 [146]

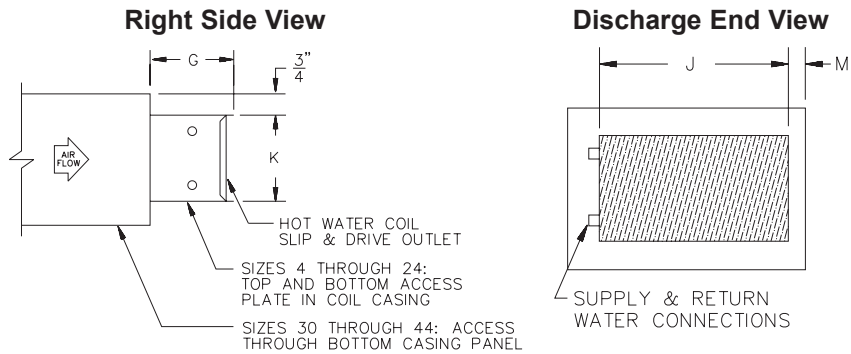


Note: All dimensions are in inches [mm].

MODEL CFR-EH ELECTRIC HEAT DETAIL

Fan Sizes 04, 06, 11, 18, 21 and 24

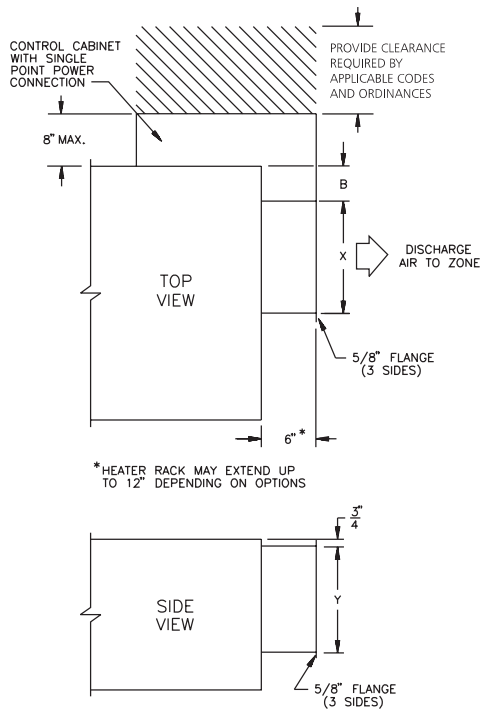

Fan Sizes 30, 40, and 44

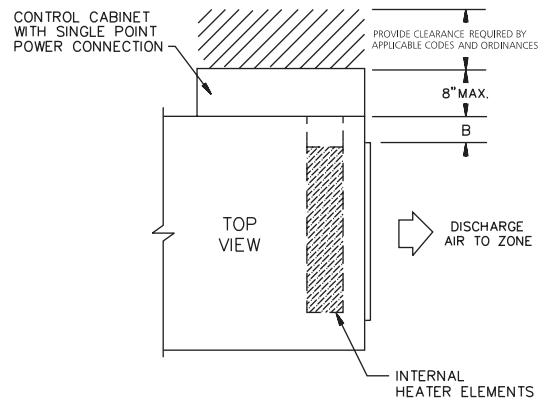

GENERAL SELECTION, 50 Hz PSC MOTOR

UNIT SIZE	CFM	MIN. ΔPs (IN. W.G.)	MAX E.S.P. (IN. W.G.)	ROOM NOISE CRITERIA (NC)				HORSEPOWER / AMPERAGE DATA															
				DIS. FAN ONLY	RADIATED INLET ΔPs			FAN HP			AMPERAGE												
					0.5"	1.0"	3.0"	LOW	MED	HI	115V			208V			277V						
0506	300	0.04	0.76	21	26	30	36	0506	1/10	1/8	1/6	2.2	2.4	2.7	.55	.9	1.4	.8	.9	1.0			
	350	0.05	0.71	28	30	33	39																
0606	300	0.10	0.76	21	23	25	33	0606	1/10	1/8	1/6	2.2	2.4	2.7	.55	.9	1.4	.8	.9	1.0			
	350	0.14	0.71	28	25	27	35																
	400	0.19	0.65	30	28	31	36																
	450	0.23	0.58	31	30	32	38																
	550	0.34	0.42	33	34	36	40																
0806	300	0.03	0.76	21	23	25	33	0806	1/10	1/8	1/6	2.2	2.4	2.7	.55	.9	1.4	.8	.9	1.0			
	350	0.04	0.71	28	25	27	35																
	400	0.05	0.65	30	28	31	36																
	450	0.06	0.58	31	30	32	38																
0611	400	0.09	0.42	33	34	36	40	0611	1/10	1/8	1/6	2.2	2.4	2.7	.55	.9	1.4	.8	.9	1.0			
	400	0.27	0.80	--	24	28	35																
	500	0.40	0.80	21	28	33	37																
	500	0.03	0.80	--	20	24	33																
0811	400	0.03	0.80	--	20	24	33	0811	1/8	1/5	1/4	3.7	4.1	4.9	1.1	1.5	2.2	1.4	1.7	2.0			
	500	0.05	0.80	21	23	27	35																
	600	0.07	0.80	24	27	31	37																
	800	0.11	0.80	25	32	35	40																
1011	1000	0.17	0.70	30	37	39	43	1011	1/8	1/5	1/4	3.7	4.1	4.9	1.1	1.5	2.2	1.4	1.7	2.0			
	600	0.03	0.80	24	26	30	37																
	800	0.06	0.80	25	33	36	41																
0818	1000	0.09	0.70	30	37	40	45	0818	1/8	1/5	1/4	3.7	4.1	4.9	1.1	1.5	2.2	1.4	1.7	2.0			
	600	0.11	0.90	20	27	30	36																
	800	0.19	0.90	21	31	32	39																
	1000	0.30	0.88	24	35	36	42																
1018	600	0.02	0.90	20	26	28	38	1018	1/4	1/3	1/2	8.8	9.3	9.6	2.3	2.7	4.0	2.8	2.9	3.6			
	800	0.04	0.90	21	27	31	39																
	1000	0.06	0.88	24	30	33	40																
	1200	0.08	0.82	29	33	36	43																
	1400	0.11	0.75	31	38	40	46																
	1600	0.15	0.59	35	41	43	48																
1218	800	0.02	0.90	21	30	32	40	1218	1/4	1/3	1/2	8.8	9.3	9.6	2.3	2.7	4.0	2.8	2.9	3.6			
	1000	0.03	0.88	24	32	36	41																
	1200	0.05	0.82	29	36	39	43																
	1400	0.06	0.75	31	39	41	46																
	1600	0.07	0.59	35	42	45	50																
1021	1800	0.09	0.40	36	45	47	51	1021	1/4	1/3	1/2	8.8	9.3	9.6	2.3	2.7	4.0	2.8	2.9	3.6			
	800	0.06	0.90	--	26	31	38																
	1000	0.10	0.90	20	30	33	40																
	1200	0.13	0.88	23	35	38	43																
	1400	0.18	0.82	25	38	40	46																
1221	1600	0.24	0.77	30	40	42	48	1221	1/3	1/2	3/4	9.4	10.3	10.5	2.5	3.2	4.2	3.6	3.7	4.3			
	800	0.02	0.90	--	24	28	40																
	1100	0.04	0.90	21	30	33	41																
	1400	0.06	0.82	25	36	38	45																
	1700	0.09	0.73	31	40	41	48																
	2000	0.13	0.54	35	43	46	51																
1421	2300	0.15	0.23	38	48	48	53	1421	1/3	1/2	3/4	9.4	10.3	10.5	2.5	3.2	4.2	3.6	3.7	4.3			
	1100	0.04	0.90	21	32	36	40																
	1400	0.06	0.82	25	38	41	46																
	1700	0.09	0.73	31	42	45	50																
	2000	0.13	0.54	35	46	47	52																
2300	0.15	0.23	38	50	51	55																	

Shaded Unit Sizes (i.e. 0606, 0811, 1018, 1221) indicate the most commonly specified selections.

See notes on following page. The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and performance data.

GENERAL SELECTION, 50 Hz PSC MOTOR

UNIT SIZE	CFM	MIN. ΔPs (IN. W.G.)	MAX E.S.P. (IN. W.G.)	ROOM NOISE CRITERIA (NC)			HORSEPOWER / AMPERAGE DATA													
				DIS. FAN ONLY	RADIATED INLET ΔPs			FAN HP			AMPERAGE									
					0.5"	1.0"	3.0"	115V			208V			277V						
							LOW	MED	HI	LOW	MED	HI	LOW	MED	HI	LOW	MED	HI		
1224	1100	0.04	1.10	--	31	36	43	1/2	3/4	1.0	8.9	11.0	12.3	1.8	2.8	5.3	3.4	3.8	4.5	
	1400	0.06	1.10	24	37	40	46													
	1700	0.09	1.03	28	39	42	48													
	2000	0.12	0.82	32	43	46	52													
	2300	0.17	0.56	35	48	48	55													
1424	1100	0.02	1.10	--	31	36	43	1/4	(2)	1/3	(2)	17.6	18.6	19.2	4.6	5.4	8.0	5.6	5.8	7.2
	1400	0.04	1.10	24	37	40	46													
	1700	0.07	1.03	28	39	42	48													
	2000	0.08	0.82	32	43	46	52													
	2300	0.11	0.56	35	48	48	55													
	2600	0.14	0.25	37	51	51	55													
1230	1100	0.04	0.90	--	26	27	33	1/3	(2)	1/2	(2)	18.8	20.6	21.0	5.0	6.4	8.4	7.2	7.4	8.6
	1500	0.05	0.85	20	30	31	38													
	1900	0.09	0.78	22	33	35	40													
	2300	0.12	0.68	26	38	38	43													
1430	1100	0.03	0.90	--	26	28	32	1/2	(2)	3/4	(2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	1500	0.05	0.85	20	30	31	38													
	1900	0.07	0.78	22	35	36	41													
	2300	0.10	0.68	26	37	38	43													
	2700	0.13	0.56	30	40	40	46													
1630	1500	0.02	0.85	20	30	31	38	1/2	(2)	3/4	(2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	1900	0.04	0.78	22	32	35	40													
	2300	0.06	0.68	26	36	38	42													
	2700	0.08	0.56	30	38	40	45													
	3100	0.10	0.40	35	41	42	47													
1440	1600	0.06	0.90	--	26	28	37	1/2	(2)	3/4	(2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	2100	0.10	0.90	21	31	33	41													
	2600	0.14	0.87	25	36	37	45													
	3100	0.20	0.80	30	41	42	47													
1640	1600	0.04	0.90	--	27	31	38	1/2	(2)	3/4	(2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	2100	0.07	0.90	21	31	33	41													
	2600	0.11	0.87	25	35	38	43													
	3100	0.15	0.80	30	41	42	47													
	3600	0.21	0.66	34	45	45	50													
	4100	0.28	0.40	37	50	50	53													
1644	2100	0.05	1.10	21	30	32	40	1/2	(2)	3/4	(2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	2600	0.09	1.10	25	33	36	42													
	3100	0.12	1.00	29	38	39	45													
	3600	0.17	0.88	33	42	43	48													
	4100	0.22	0.62	36	46	46	51													
1844	2100	0.10	1.10	21	27	34	43	1/2	(2)	3/4	(2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	2600	0.15	1.10	25	31	37	45													
	3100	0.22	1.00	29	36	40	46													
	3600	0.30	0.88	33	40	42	48													
	4100	0.44	0.62	36	43	45	52													
	4600	0.56	0.33	39	50	50	56													

Shaded Unit Sizes (i.e. 1430, 1640) indicate the most commonly specified selections.

NOTES:

- Min. ΔPs is the static pressure difference across the primary air valve with the damper wide open. All downstream losses (including optional hot water coil) are handled by the unit fan and need not be considered for primary air performance calculations.
- Max. E.S.P. is the external static pressure available on high tap at the airflow capacity indicated. Optional hot water coil pressure loss is not included with these values.
- Performance data obtained from tests conducted in accordance with AHRI Standard 880.
- Dash (-) indicates NC level less than 20.
- NC values are calculated using attenuation values provided in appendix E of AHRI 885-2008, as shown on the right.

DISCHARGE ATTENUATION VALUES	OCTAVE BAND						
	2	3	4	5	6	7	
Small Box (< 300 CFM)	24	28	39	53	59	40	
Medium Box (300-700 CFM)	27	29	40	51	53	39	
Large Box (> 700 CFM)	29	30	41	51	52	39	

RADIATED ATTENUATION VALUES	OCTAVE BAND						
	2	3	4	5	6	7	
Type 2 - Mineral Fiber Ceiling	18	19	20	26	31	36	

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and performance data.

SOUND POWER DATA, 50 Hz PSC MOTOR

UNIT SIZE	CFM	DISCHARGE							RADIATED																											
		FAN ONLY							0.5" INLET ΔPs							1.0" INLET ΔPs							1.5" INLET ΔPs							3.0" INLET ΔPs						
		OCTAVE BAND NUMBER							OCTAVE BAND NUMBER							OCTAVE BAND NUMBER							OCTAVE BAND NUMBER							OCTAVE BAND NUMBER						
	2	3	4	5	6	7	2	3	4	5	6	7	2	3	4	5	6	7	2	3	4	5	6	7	2	3	4	5	6	7						
0506	300	68	57	54	52	48	45	59	56	52	46	43	45	63	60	55	48	48	48								64	64	61	54	51	50				
	350	73	63	58	56	53	50	62	58	55	48	47	48	66	63	57	50	46	48								68	67	64	57	53	51				
0606	200	63	55	51	47	43	40	53	49	46	42	37	41	54	51	48	43	40	41								57	56	54	51	47	46				
	300	68	57	54	52	48	45	56	53	49	42	38	41	58	56	51	44	40	41								62	60	58	51	47	46				
	350	73	63	58	56	53	50	58	55	51	44	40	42	60	58	53	46	41	42								64	62	60	53	48	46				
	400	75	66	61	59	56	54	60	58	54	47	41	42	62	60	56	48	42	43								66	64	61	54	48	47				
	450	76	68	62	60	57	56	62	60	55	49	42	41	63	62	57	50	43	42								67	66	63	55	49	47				
550	77	70	64	63	59	58	65	63	59	52	46	44	66	65	60	53	47	45								69	68	65	57	51	49					
0806	300	68	57	54	52	48	45	56	53	49	42	38	41	58	56	51	44	40	41	60	58	54	47	43	43	62	60	58	51	47	46					
	350	73	63	58	56	53	50	58	55	51	44	40	42	60	58	53	46	41	42	62	60	56	49	44	44	64	62	60	53	48	46					
	400	75	66	61	59	56	54	60	58	54	47	41	42	62	60	56	48	42	43	64	62	58	50	44	44	66	64	61	54	48	47					
	450	76	68	62	60	57	56	62	60	55	49	42	41	63	62	57	50	43	42	64	64	59	52	45	44	67	66	63	55	49	47					
550	77	70	64	63	59	58	65	63	59	52	46	44	66	65	60	53	47	45	68	67	63	55	49	47	69	68	65	57	51	49						
0611	400	66	56	55	53	49	48	59	55	50	44	33	29	61	58	54	46	40	37								65	62	60	54	49	47				
	500	68	59	58	55	52	51	62	59	54	48	38	33	63	62	58	49	42	39								68	65	62	56	50	48				
0811	400	66	56	55	53	49	48	56	52	46	38	32	32	58	55	50	43	37	37								62	59	58	53	47	47				
	500	68	59	58	57	53	53	58	55	48	40	33	33	61	58	52	45	39	38								65	62	60	55	48	48				
	600	70	61	60	57	54	53	60	58	51	43	35	35	63	61	54	47	40	39								67	65	62	56	49	49				
	800	73	65	64	62	58	58	65	62	56	50	40	40	66	64	58	51	43	42								72	69	64	57	50	50				
1000	77	69	67	67	63	62	68	66	59	54	45	46	70	68	61	56	47	47								74	72	67	60	52	52					
1011	600	70	61	60	57	54	53	61	57	51	44	34	32	64	60	55	47	38	37	65	62	58	50	41	40	67	65	62	54	47	46					
	800	73	65	64	62	58	58	66	63	57	50	40	40	69	65	59	51	42	41	70	67	61	53	45	44	72	70	65	57	49	48					
0818	1000	77	69	67	67	63	62	69	66	60	53	44	44	71	69	62	55	46	46	72	69	62	54	46	46	74	73	67	60	51	50					
	1100	78	71	68	68	65	64	70	67	61	54	45	46	71	70	62	55	47	47	75	73	67	60	51	50	76	73	68	61	52	52					
	600	67	58	55	50	48	45	56	58	49	41	37	33	59	60	53	45	38	35								65	65	60	53	47	44				
	800	69	63	60	56	53	51	62	61	54	46	39	37	63	62	57	48	41	37								69	68	63	56	50	47				
	1000	72	66	63	61	58	56	65	64	58	50	43	40	66	65	61	52	45	41								72	71	66	58	52	49				
1018	600	67	58	55	51	48	45	55	57	48	38	32	29	59	59	52	43	38	35								63	64	63	54	47	46				
	800	69	63	60	56	53	51	58	58	50	39	33	31	62	61	55	46	39	36								67	67	64	55	49	47				
	1000	72	66	63	61	58	56	62	60	52	44	38	36	64	63	56	47	41	38								71	69	65	56	50	48				
	1200	75	70	66	64	61	60	65	63	56	48	42	40	67	65	58	50	43	41								73	72	66	58	52	50				
	1400	77	72	69	67	65	64	69	67	58	51	46	45	71	69	61	53	47	46								76	74	67	60	54	52				
1600	78	75	71	70	67	67	72	70	61	54	49	48	73	72	63	56	50	49								78	76	69	62	55	54					
1218	800	69	63	60	56	53	51	60	60	52	46	37	32	62	62	55	48	42	38	64	64	59	51	45	42	66	67	65	57	50	49					
	1000	72	66	63	61	58	56	63	62	54	48	41	38	65	65	57	50	45	42	66	66	60	53	48	45	69	69	66	58	52	50					
	1200	75	70	66	64	61	60	66	65	57	51	46	44	69	68	60	53	48	46	70	70	63	55	50	48	73	72	67	59	53	51					
	1400	77	72	69	67	65	64	68	68	59	53	48	47	71	70	62	55	50	48	72	72	64	57	52	50	75	74	68	60	54	53					
	1600	78	75	71	70	67	67	71	71	62	56	51	50	73	73	64	57	52	50	76	75	67	59	54	52	77	77	69	62	56	55					
1800	80	76	73	73	70	70	73	73	64	58	53	52	75	75	66	59	54	53	76	76	68	60	56	54	79	78	71	63	58	56						
1021	800	66	57	56	54	51	48	60	57	50	43	34	30	63	61	54	46	40	37								68	66	63	55	49	48				
	1000	69	62	61	58	55	53	65	60	53	46	36	33	67	63	57	49	42	39								72	69	65	57	51	50				
	1200	71	65	64	62	59	58	69	64	57	50	42	41	70	67	59	52	45	43								75	72	67	59	52	51				
	1400	73	67	66	65	62	61	71	67	60	53	45	43	72	69	61	54	47	45								77	74	68	60	54	52				
1600	77	71	69	68	65	64	73	69	62	55	47	45	74	71	63	56	50	49								79	76	70	62	55	54					

Shaded Unit Sizes (i.e. 0606, 0811, 1018) indicate the most commonly specified selections.

NOTES:

- Data obtained from tests conducted in accordance with AHRI Standard 880.
- Sound levels are expressed in decibels, dB re: 1 x 10⁻¹² Watts.
- Fan external static pressure is 0.25 inches w.g.
- Duct end corrections included in sound power levels per AHRI Standard 880.
- Certified AHRI data is highlighted blue. Application data (not highlighted blue) is outside the scope of the certification program.

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and performance data.



FAN PERFORMANCE, 50 Hz PSC MOTOR

GENERAL FAN NOTE







The fan curves depicted on this page are for 50 Hz PSC type motors. Each fan curve depicts the actual performance for the relative motor tap without any additional fan balance adjustment. Actual specified capacities which fall below a particular fan curve (LOW, MED or HI) can be obtained by adjustment of the electronic fan speed controller. Selections should only be made in the visible area below and/or to the left of each particular fan curve. The minimum external static pressure requirement is shown for each fan assembly. The unit fan should not be energized prior to realizing this minimum external static pressure.

NOTE:

Terminals equipped with a hot-water heating coil require the addition of the coil pressure drop to the specified external static pressure before making the fan selection.

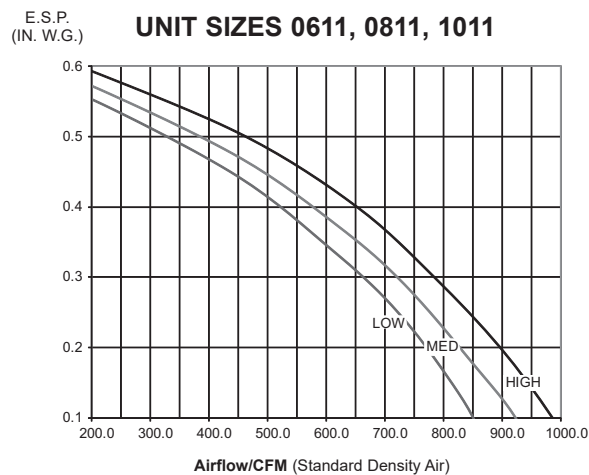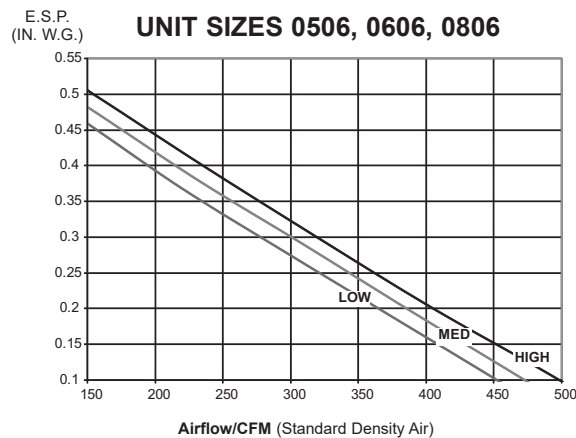

FAN PERFORMANCE, 50 Hz PSC MOTOR

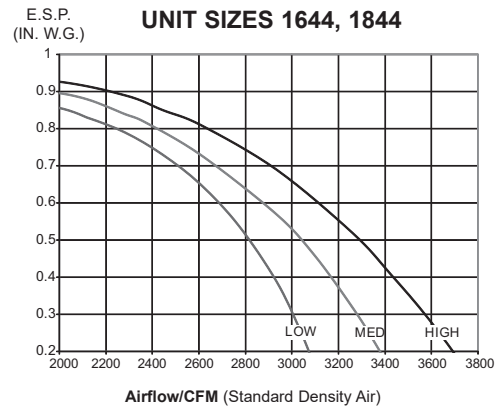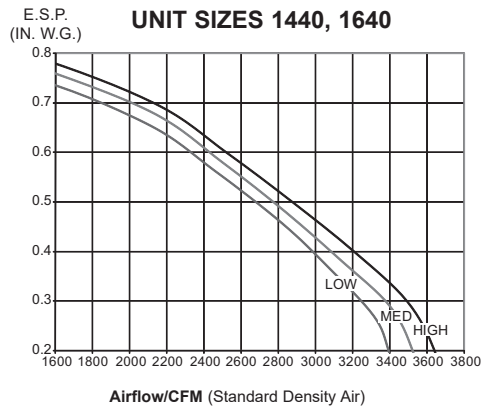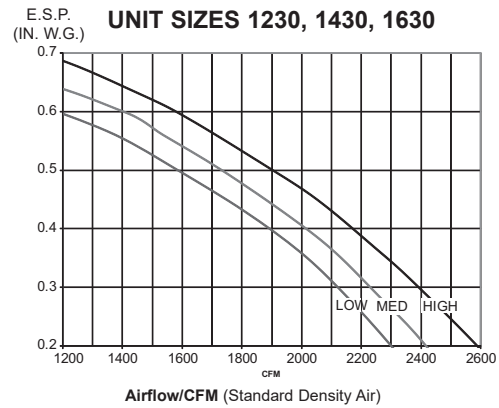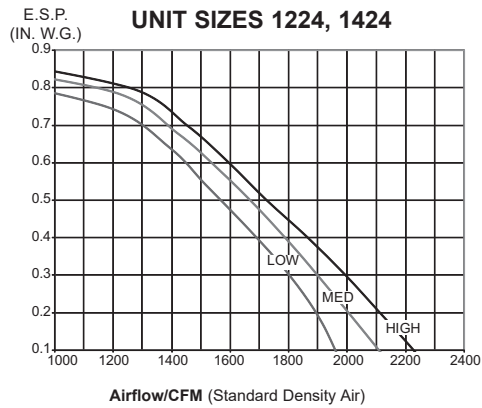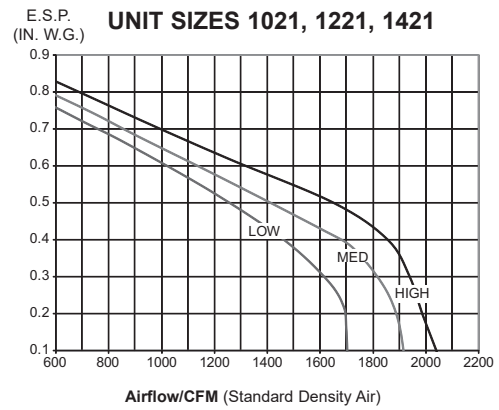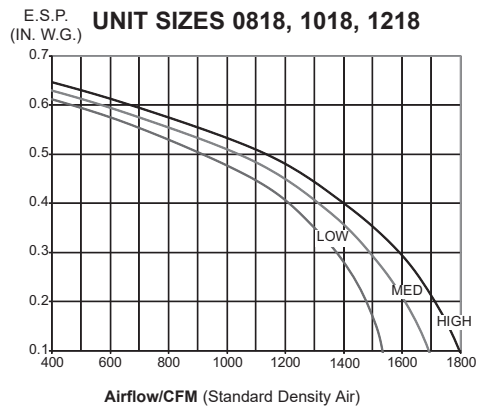

GENERAL SELECTION, 60 Hz PSC MOTOR

UNIT SIZE	CFM	MIN. ΔPs (IN. W.G.)	MAX E.S.P. (IN. W.G.)	ROOM NOISE CRITERIA (NC)			HORSEPOWER / AMPERAGE DATA													
				DIS. FAN ONLY	RADIATED INLET ΔPs			FAN HP			AMPERAGE									
					0.5"	1.0"	3.0"	LOW	MED	HI	115V		208V		277V					
0404	100	0.01	0.70	--	27	27	27													
	150	0.02	0.70	--	27	28	30													
	200	0.03	0.67	--	28	28	33													
	250	0.04	0.60	--	32	32	36													
0504	100	0.01	0.70	--	22	25	26													
	200	0.02	0.67	--	22	25	30													
	250	0.02	0.60	--	25	27	32													
	300	0.03	0.51	--	27	30	35													
0604	350	0.04	0.42	--	33	35	36													
	200	0.05	0.67	--	23	23	28													
	250	0.07	0.60	--	28	30	31													
	300	0.10	0.51	--	28	30	33													
0506	350	0.14	0.42	--	32	33	36													
	400	0.19	0.30	--	33	33	36													
	300	0.04	0.76	21	26	30	36													
	350	0.05	0.71	28	30	33	39													
0606	300	0.10	0.76	21	23	25	33													
	350	0.14	0.71	28	25	27	35													
	400	0.19	0.65	30	28	31	36													
	450	0.23	0.58	31	30	32	38													
0806	550	0.34	0.42	33	34	36	40													
	300	0.03	0.76	21	23	25	33													
	350	0.04	0.71	28	25	27	35													
	400	0.05	0.65	30	28	31	36													
0611	450	0.06	0.58	31	30	32	38													
	550	0.09	0.42	33	34	36	40													
	400	0.27	0.80	--	24	28	35													
	500	0.40	0.80	21	28	33	37													
0811	400	0.03	0.80	--	20	24	33													
	500	0.05	0.80	21	23	27	35													
	600	0.07	0.80	24	27	31	37													
	800	0.11	0.80	25	32	35	40													
1011	1000	0.17	0.70	30	37	39	43													
	600	0.03	0.80	24	26	30	37													
	800	0.06	0.80	25	33	36	41													
	1000	0.09	0.70	30	37	40	45													
1018	600	0.11	0.90	20	27	30	36													
	800	0.19	0.90	21	31	32	39													
	1000	0.30	0.88	24	35	36	42													
	600	0.02	0.90	20	26	28	38													
1218	800	0.04	0.90	21	27	31	39													
	1000	0.06	0.88	24	30	33	40													
	1200	0.08	0.82	29	33	36	43													
	1400	0.11	0.75	31	38	40	46													
1021	1600	0.15	0.59	35	41	43	48													
	800	0.02	0.90	21	30	32	40													
	1000	0.03	0.88	24	32	36	41													
	1200	0.05	0.82	29	36	39	43													
1221	1400	0.06	0.75	31	39	41	46													
	1600	0.07	0.59	35	42	45	50													
	1800	0.09	0.40	36	45	47	51													
	800	0.06	0.90	--	26	31	38													
1421	1000	0.10	0.90	20	30	33	40													
	1200	0.13	0.88	23	35	38	43													
	1400	0.18	0.82	25	38	40	46													
	1600	0.24	0.77	30	40	42	48													
1221	800	0.02	0.90	--	24	28	40													
	1100	0.04	0.90	21	30	33	41													
	1400	0.06	0.82	25	36	38	45													
	1700	0.09	0.73	31	40	41	48													
1421	2000	0.13	0.54	35	43	46	51													
	2300	0.15	0.23	38	48	48	53													
	1100	0.04	0.90	21	32	36	40													
	1400	0.06	0.82	25	38	41	46													
1421	1700	0.09	0.73	31	42	45	50													
	2000	0.13	0.54	35	46	47	52													
	2300	0.15	0.23	38	50	51	55													

Shaded Unit Sizes (i.e. 0404, 0504, 0606, 0811, 1018, 1221) indicate the most commonly specified selections.

See notes on following page. The web-based Computer Selection Program "Web-Select" is available through your ENVIRO-TEC representative for complete CFR selection and performance data.

GENERAL SELECTION, 60 Hz PSC MOTOR

UNIT SIZE	CFM	MIN. ΔPs (IN. W.G.)	MAX E.S.P. (IN. W.G.)	ROOM NOISE CRITERIA (NC)			HORSEPOWER / AMPERAGE DATA												
				DIS. FAN ONLY	RADIATED INLET ΔPs			FAN HP			AMPERAGE								
					0.5"	1.0"	3.0"	115V			208V			277V					
							LOW	MED	HI	LOW	MED	HI	LOW	MED	HI	LOW	MED	HI	
1224	1100	0.04	1.10	--	31	36	43	1/2	3/4	1.0	8.9	11.0	12.3	1.8	2.8	5.3	3.4	3.8	4.5
	1400	0.06	1.10	24	37	40	46												
	1700	0.09	1.03	28	39	42	48												
	2000	0.12	0.82	32	43	46	52												
	2300	0.17	0.56	35	48	48	55												
1424	1100	0.02	1.10	--	31	36	43	1/4 (2)	1/3 (2)	1/2 (2)	17.6	18.6	19.2	4.6	5.4	8.0	5.6	5.8	7.2
	1400	0.04	1.10	24	37	40	46												
	1700	0.07	1.03	28	39	42	48												
	2000	0.08	0.82	32	43	46	52												
	2300	0.11	0.56	35	48	48	55												
	2600	0.14	0.25	37	51	51	55												
1230	1100	0.04	0.90	--	26	27	33	1/3 (2)	1/2 (2)	3/4 (2)	18.8	20.6	21.0	5.0	6.4	8.4	7.2	7.4	8.6
	1500	0.05	0.85	20	30	31	38												
	1900	0.09	0.78	22	33	35	40												
	2300	0.12	0.68	26	38	38	43												
1430	1100	0.03	0.90	--	26	28	32	1/2 (2)	3/4 (2)	1.0 (2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	1500	0.05	0.85	20	30	31	38												
	1900	0.07	0.78	22	35	36	41												
	2300	0.10	0.68	26	37	38	43												
	2700	0.13	0.56	30	40	40	46												
1630	1500	0.02	0.85	20	30	31	38	1/2 (2)	3/4 (2)	1.0 (2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	1900	0.04	0.78	22	32	35	40												
	2300	0.06	0.68	26	36	38	42												
	2700	0.08	0.56	30	38	40	45												
	3100	0.10	0.40	35	41	42	47												
1440	1600	0.06	0.90	--	26	28	37	1/2 (2)	3/4 (2)	1.0 (2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	2100	0.10	0.90	21	31	33	41												
	2600	0.14	0.87	25	36	37	45												
	3100	0.20	0.80	30	41	42	47												
1640	1600	0.04	0.90	--	27	31	38	1/2 (2)	3/4 (2)	1.0 (2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	2100	0.07	0.90	21	31	33	41												
	2600	0.11	0.87	25	35	38	43												
	3100	0.15	0.80	30	41	42	47												
	3600	0.21	0.66	34	45	45	50												
	4100	0.28	0.40	37	50	50	53												
1644	2100	0.05	1.10	21	30	32	40	1/2 (2)	3/4 (2)	1.0 (2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	2600	0.09	1.10	25	33	36	42												
	3100	0.12	1.00	29	38	39	45												
	3600	0.17	0.88	33	42	43	48												
	4100	0.22	0.62	36	46	46	51												
1844	2100	0.10	1.10	21	27	34	43	1/2 (2)	3/4 (2)	1.0 (2)	17.8	22.0	24.6	3.6	5.6	10.6	6.8	7.6	9.0
	2600	0.15	1.10	25	31	37	45												
	3100	0.22	1.00	29	36	40	46												
	3600	0.30	0.88	33	40	42	48												
	4100	0.44	0.62	36	43	45	52												
	4600	0.56	0.33	39	50	50	56												

Shaded Unit Sizes (i.e. 1430, 1640) indicate the most commonly specified selections.

NOTES:

- Min. ΔPs is the static pressure difference across the primary air valve with the damper wide open. All downstream losses (including optional hot water coil) are handled by the unit fan and need not be considered for primary air performance calculations.
- Max. E.S.P. is the external static pressure available on high tap at the airflow capacity indicated. Optional hot water coil pressure loss is not included with these values.
- Performance data obtained from tests conducted in accordance with AHRI Standard 880.
- Dash (-) indicates NC level less than 20.
- NC values are calculated using attenuation values provided in appendix E of AHRI 885-2008, as shown on the right.

DISCHARGE ATTENUATION VALUES	OCTAVE BAND					
	2	3	4	5	6	7
Small Box (< 300 CFM)	24	28	39	53	59	40
Medium Box (300-700 CFM)	27	29	40	51	53	39
Large Box (> 700 CFM)	29	30	41	51	52	39

RADIATED ATTENUATION VALUES	OCTAVE BAND					
	2	3	4	5	6	7
Type 2 - Mineral Fiber Ceiling	18	19	20	26	31	36

The web-based Computer Selection Program "Web-Select" is available through your ENVIRO-TEC representative for complete CFR selection and performance data.




FAN PERFORMANCE, 60 Hz PSC MOTOR

GENERAL FAN NOTE







The fan curves depicted on this page are for PSC type motors. Each fan curve depicts the actual performance for the relative motor tap without any additional fan balance adjustment. Actual specified capacities which fall below a particular fan curve (LOW, MED or HI) can be obtained by adjustment of the electronic fan speed controller. Selections should only be made in the non-shaded areas. The minimum external static pressure requirement is shown for each fan assembly. The unit fan should not be energized prior to realizing this minimum external static pressure.

NOTE:

Terminals equipped with a hot-water heating coil require the addition of the coil pressure drop to the specified external static pressure before making the fan selection.

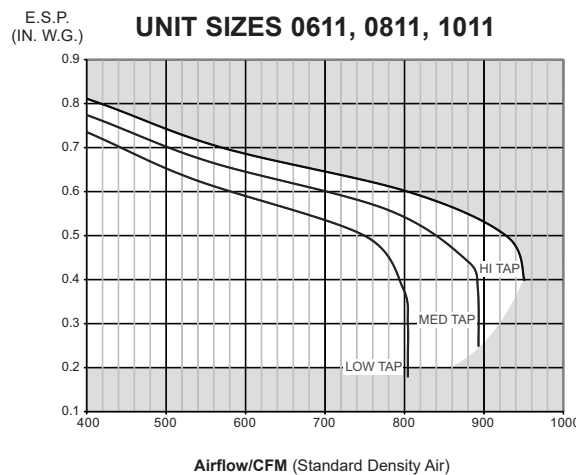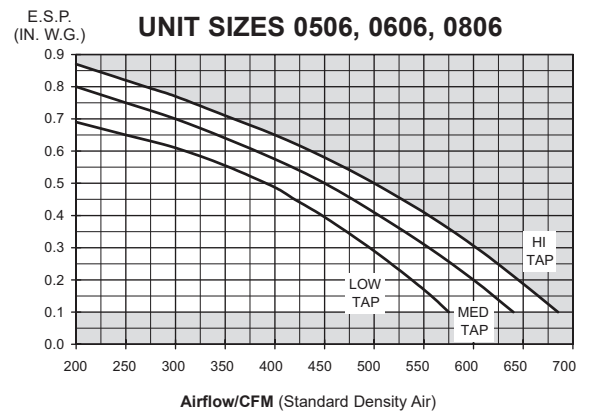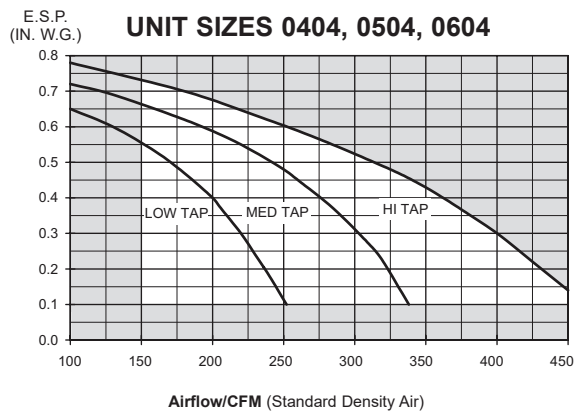

FAN PERFORMANCE, 60 Hz PSC MOTOR

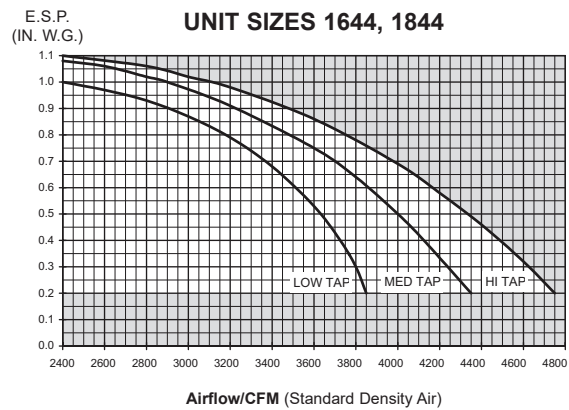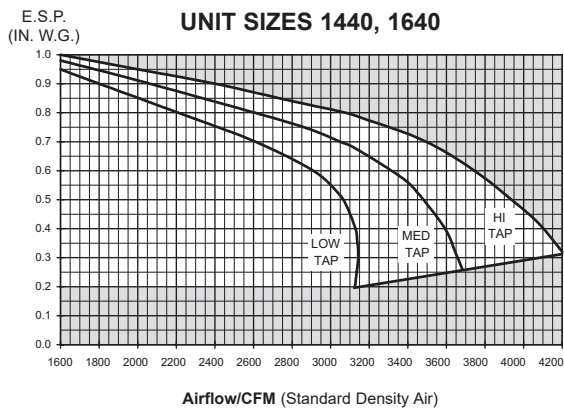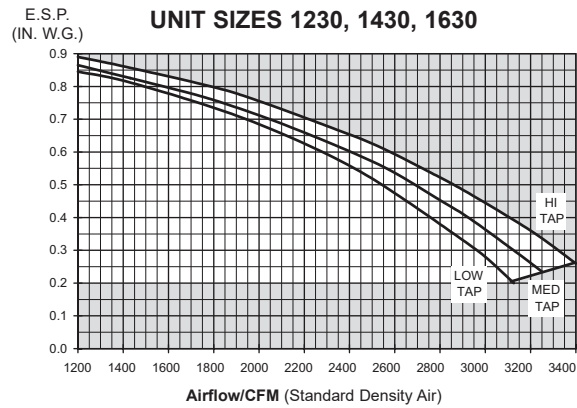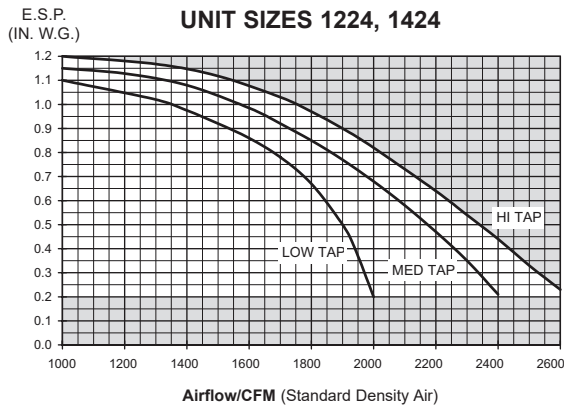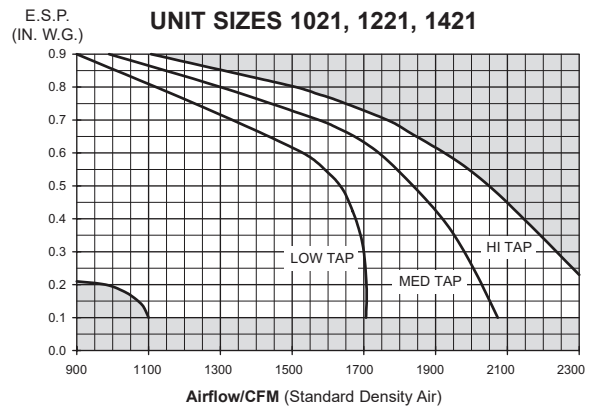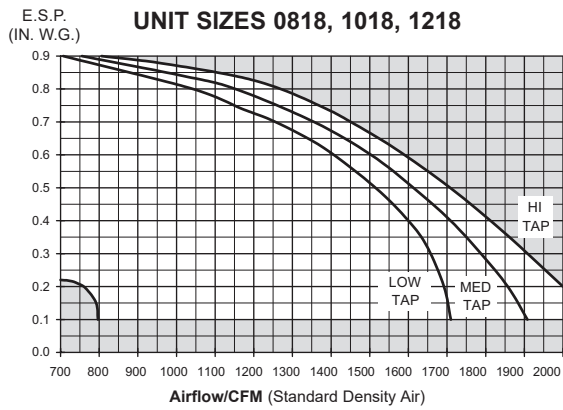

EC FAN MOTOR OPTION

THE ENERGY EFFICIENT SOLUTION

ENVIRO-TEC offers an alternative to the PSC motor that significantly increases the operating efficiency of fan terminal units. This motor is frequently referred to as an ECM (electronically commutated motor). It is a brushless DC (BLDC) motor utilizing a permanent magnet rotor. The motor has been in production for years and is commonly used in residential HVAC units. Fan speed control is accomplished through a microprocessor based variable speed controller (inverter) integral to the motor. The motor provides **peak efficiency ratings between 70 & 80%** for most applications.

ECM FEATURES AND BENEFITS

Ultra-High Motor & Controller Energy Efficiency

DC motors are significantly more efficient than AC motors. At full load the EC motor is typically 20% more efficient than a standard induction motor. Due to acoustical considerations, the fan motor on a fan powered terminal typically operates considerably less than full load. At this condition the overall motor / controller (SCR) efficiency can be cut in half. Due to the permanent magnet, DC design, the EC motor maintains a high efficiency at low speeds. Most fan powered unit selections will have an overall efficiency greater than 75%. Furthermore, the motor heat gain is greatly reduced providing additional energy savings by reducing the cold primary air requirement.

Pressure Independent Fan Volume

The integral microprocessor based controller includes a feature that provides sensorless (no external feedback) constant airflow operation by automatically adjusting the speed and torque in response to system pressure changes. This breakthrough will no doubt have far reaching benefits and endless applications. For starters, the fan volume supplied to the space will not significantly change as a filter becomes loaded. This provides new opportunities for medical applications where space pressurization and HEPA filters are applied. The air balance process will become simpler and more accurate since the fan volume will not need to be re-adjusted after the diffuser balance is accomplished.

Factory Calibrated Fan Volume

Due to the pressure independent feature, the fan capacity can now be calibrated at the factory. Within the published external pressure limits, the fan motor will automatically adjust to account for the varying static pressure requirements associated with different downstream duct configurations. This feature should not preclude the final field air balance verification process during the commissioning stage of a project. An electronic (PWM) speed control device is provided to

allow field changes of the fan capacity as the need arises. Fan volume can be field calibrated in two fashions depending on the type of PWM control board provided on the unit. For the Solo PWM board, a potentiometer is provided allowing manual adjustment using an instrument type screwdriver. If a Sync PWM board is provided, the fan volume can be calibrated through the BMS using an analog output (2 to 10VDC typical) to the speed controller. A fan volume versus DC volts calibration chart is provided.

Designer / Owner Flexibility



The ECM incorporates ball bearings in lieu of sleeve bearings typically utilized with an induction motor. Unlike a sleeve bearing motor, the ECM does not have a minimum RPM requirement for

bearing lubrication. This allows it to operate over a much wider speed range. One motor can handle the capacity range previously handled by two motors, allowing simplification of the product line and considerable flexibility to the designer. The owner also benefits since equipment changes are much less likely with tenant requirement changes. A reduced spare parts inventory is another plus.

Custom Applications — Programmable Fan Operation

Boundless control opportunities arise due to the controllability of a DC motor combined with an integral microprocessor. Various input signals can direct the motor to behave in an application specific mode. For instance, multiple discrete fan capacities can be achieved. In addition, the fan speed can be varied in response to the space temperature load. The fan can also be programmed for a soft start. The motor starts at a very low speed and slowly ramps up to the required speed.

Extended Motor Life

The high motor efficiency provides a significantly reduced operating temperature compared to an induction motor. The lower temperature increases the longevity of all electrical components and therefore the life of the motor. The ball bearings do not require lubrication and do not adversely impact the motor life. Most fan powered applications will provide a motor life between 60,000 and 100,000 hours. A motor life of twenty five years will not be uncommon for a series flow fan terminal and a longer life can be expected for a parallel flow unit.

GENERAL SELECTION, 60 Hz EC MOTOR

UNIT SIZE	CFM	MIN ΔPs ¹ (IN W.G.)	PROJECTED ROOM NOISE CRITERION (NC) ²				FAN HP	VOLTS	FLA ³	
			DIS. FAN ONLY	RADIATED						
				0.5" INLET ΔPs	1.0" INLET ΔPs	3.0" INLET ΔPs				
0611	200	0.07	--	--	20	28	120	5.0		
	300	0.15	--	--	24	32				
	400	0.27	--	--	24	35				
	500	0.40	--	--	28	37				
0811	400	0.03	--	--	20	33	1/3	2.6		
	500	0.05	--	--	23	35				
	600	0.07	--	--	27	37				
	800	0.11	22	32	35	40				
1011	900	0.14	25	35	37	41	1/2	7.7		
	600	0.03	--	--	26	30			120	4.1
	800	0.06	22	33	36	41				
900	0.08	25	35	38	43					
0818	600	0.11	--	--	27	30	1/2	9.6		
	800	0.19	--	--	31	32				
	1000	0.30	23	35	36	42				
1018	600	0.02	--	--	26	28	3/4	5.5		
	800	0.04	--	--	27	31				
	1000	0.06	23	30	33	40				
	1200	0.08	27	33	36	43				
1218	1400	0.11	30	38	40	46	1	12.8		
	800	0.02	--	--	30	32			277	6.9
	1000	0.03	23	32	36	41				
	1200	0.05	26	36	39	43				
1421	1400	0.06	30	39	41	46	2 @ 1/2	15.4		
	600	0.04	--	--	20	24			120	8.2
	800	0.06	--	--	26	31				
	1000	0.10	--	--	30	33				
1221	1200	0.13	24	35	38	43	1	12.8		
	1400	0.18	26	38	40	46				
	1600	0.24	29	40	42	48				
	600	0.01	--	--	20	24			277	6.9
800	0.02	--	--	24	28					
1100	0.04	21	30	33	41					
1400	0.06	26	36	38	45					
1424	1700	0.09	31	40	41	48	1	12.8		
	2000	0.13	35	43	46	51				
	600	0.01	--	--	20	24			277	6.9
	800	0.02	--	--	24	28				
1100	0.04	21	32	36	40					
1440	1400	0.06	26	37	40	46	1	12.8		
	1700	0.09	29	39	42	48				
	2000	0.12	32	43	46	52				
	2300	0.17	35	48	48	55				
1640	1400	0.04	26	37	40	46	1	12.8		
	1700	0.08	29	39	42	48				
	2000	0.11	32	43	46	52				
	2350	0.12	35	48	48	55				
1640	1600	0.06	--	--	26	28	2 @ 1/2	15.4		
	2100	0.10	22	31	33	41				
	2600	0.14	27	36	37	45				
	3100	0.20	31	41	42	47				
1640	1600	0.04	--	--	27	31	277	8.2		
	2100	0.07	22	31	33	41				
	2600	0.11	27	35	38	43				
3100	0.15	31	41	42	47					

Most variable speed electronic devices, including the EC motor, operate with a rectified and filtered AC power. As a result of the power conditioning, the input current draw is not sinusoidal; rather, the current is drawn in pulses at the peaks of the AC voltage. This pulsating current includes high frequency components called harmonics.

Harmonic currents circulate on the delta side of a Delta-Wye distribution transformer. On the Wye side of the transformer, these harmonic currents are additive on the neutral conductor. A transformer used in this type of application must be sized to carry the output KVA that will include the KVA due to circulating currents.

Careful design must be provided when connecting single-phase products to three-phase systems to avoid potential problems such as overheating of neutral wiring conductors, connectors, and transformers. In addition, design consideration must be provided to address the degradation of power quality by the creation of wave shape distortion.

In summary, proper consideration must be given to the power distribution transformer selection and ground neutral conductor design to accommodate the 3-phase neutral AMPs shown in the adjacent table. Specific guidelines are available from the factory.

NOTES:

1. Min. ΔPs is the static pressure difference across the primary air valve with the damper wide open. All downstream losses (including optional hot water coil) are handled by the unit fan and need not be considered for primary air performance calculations. Data is certified in accordance with the AHRI 880 certification program.
2. NC values calculated based upon the 2002 Addendum to AHRI Standard 885 Appendix E **Typical Sound Attenuation Values** (shown at right).
3. Calculate wire feeder size and maximum overcurrent protective device per NEC and local code requirements. Recommended fuse type shall be UL Class RK5, J, CC or other motor rated fuse.
4. For three-phase conductor sizing, multiply FLA by 1.73.
5. Includes factory provided 2mH choke for power factor correction.

DISCHARGE ATTENUATION VALUES	OCTAVE BAND					
	2	3	4	5	6	7
Small Box (< 300 CFM)	24	28	39	53	59	40
Medium Box (300-700 CFM)	27	29	40	51	53	39
Large Box (> 700 CFM)	29	30	41	51	52	39






RADIATED ATTENUATION VALUES	OCTAVE BAND					
	2	3	4	5	6	7
Type 2 - Mineral Fiber Ceiling	18	19	20	26	31	36

FAN PERFORMANCE, 60 Hz EC MOTOR

GENERAL FAN NOTE

The fan curves depicted on this page are for EC motors. Actual specified capacities which fall below the fan curve can be obtained by adjustment of the fan speed controller. Selections should only be made in the non-shaded areas. The minimum external static pressure requirement is shown for each fan assembly. The unit fan should not be energized prior to realizing this minimum external static pressure.

Terminals equipped with a hot water heating coil require the addition of the coil pressure drop to the specified external static pressure before making the fan selection.

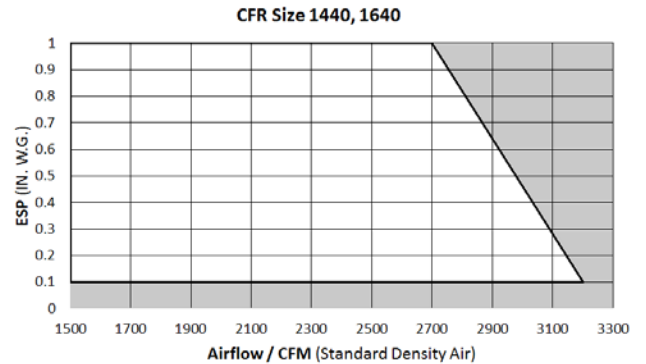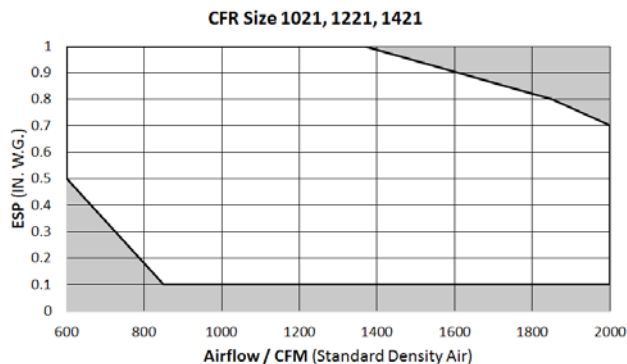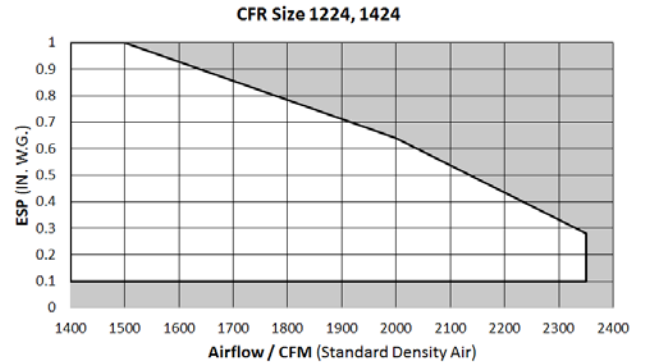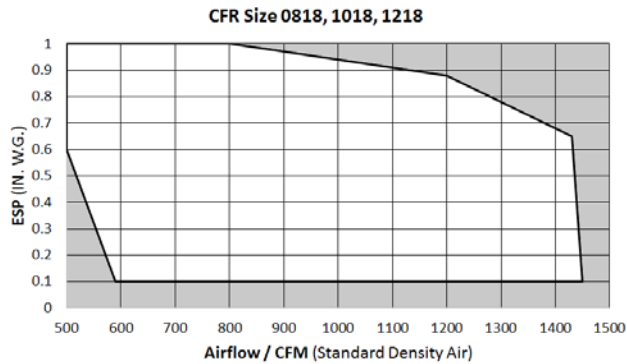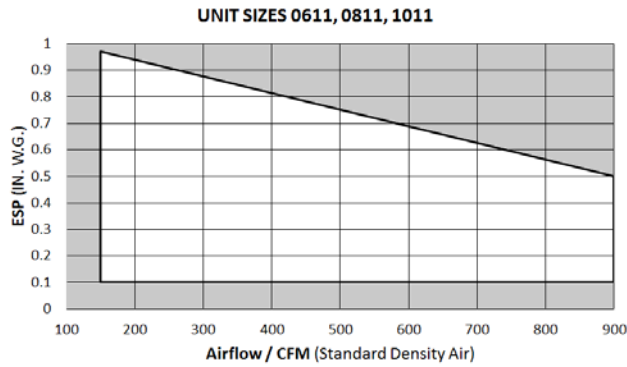

AHRI RATINGS

AIRFLOW & PRESSURE

SIZE	PRIMARY AIRFLOW RATE (CFM)	FAN AIRFLOW RATE (CFM)	ELECTRICAL POWER INPUT (WATTS)	MINIMUM SUPPLY OPERATING PRESSURE (IN. W.G.)	MINIMUM FAN DISCHARGE STATIC PRESSURE (IN. W.G.)
0404	150	400	125	0.02	0.10
0504	250	400	125	0.02	0.10
0604	400	400	125	0.19	0.10
0506	250	550	175	0.03	0.10
0606	400	550	175	0.19	0.10
0806	550	550	175	0.09	0.10
0611	400	900	485	0.27	0.10
0811	700	900	485	0.10	0.10
1011	900	900	485	0.11	0.10
0818	700	1600	665	0.15	0.10
1018	1100	1600	665	0.08	0.10
1218	1600	1600	665	0.07	0.10
1021	1100	2100	1055	0.12	0.10
1221	1600	2100	1055	0.07	0.10
1421	2100	2100	1055	0.14	0.10
1224	1600	2600	1060	0.08	0.20
1424	2100	2600	1060	0.11	0.20
1230	1600	2800	960	0.07	0.20
1430	2100	2800	960	0.06	0.20
1630	2800	2800	960	0.07	0.20
1440	2100	3600	1660	0.10	0.25
1640	2800	3600	1660	0.13	0.25
1644	2800	4600	2300	0.09	0.20
1844	3500	4600	2300	0.29	0.20



SOUND RATINGS

SIZE	PRIMARY AIRFLOW RATE (CFM)	FAN AIRFLOW RATE (CFM)	ELECTRICAL POWER INPUT (WATTS)	MINIMUM SUPPLY OPERATING PRESSURE (IN. W.G.)	STANDARD RATINGS - SOUND POWER LEVEL, dB RE: 1 X 10 ⁻¹² WATTS																	
					RADIATED												DISCHARGE					
					FAN ONLY						1.5" WATER STATIC PRESSURE						FAN ONLY					
					Hz	Octave	Band	Center	Frequency		Hz	Octave	Band	Center	Frequency		Hz	Octave	Band	Center	Frequency	
0604	400	400	140	0.19	65	64	52	46	39	37	68	65	58	50	42	41	66	61	56	59	54	51
0806	550	550	175	0.09	65	61	55	49	42	42	68	67	63	55	49	47	77	70	64	63	59	58
1011	1100	1100	480	0.11	69	66	60	55	47	48	75	73	67	60	51	50	78	71	68	68	65	64
1218	1600	1600	670	0.07	70	68	59	56	53	52	76	75	67	59	54	52	78	75	71	70	67	67
1421	2100	2100	950	0.14	73	69	62	57	52	52	80	78	69	61	56	55	82	76	73	74	71	71
1630	2800	2800	960	0.07	72	69	61	55	51	49	76	71	64	56	49	49	75	73	71	70	66	66
1844	3500	3500	1880	0.29	69	69	62	57	51	49	76	73	67	61	56	54	75	73	72	71	69	68

NOTE: Based on standard PSC motor.

- Duct end corrections included in sound power levels per AHRI Standard 880.

ELECTRIC HEAT

MODEL CFR-EH

STANDARD FEATURES

- cETL listed as an assembly for safety compliance per UL 1995
- Primary auto-reset high limit
- Secondary high limit
- Hinged control panel
- Ni-Chrome elements
- Primary/secondary power terminations
- Fusing per NEC
- Wiring diagram and ETL label
- Fan interlock device (relay or P.E. switch)
- Single point power connection
- Available kW increments are as follows:
0.5 to 5.0 kW - .25 kW; 5.0 to 10.0 kW - .50 kW;
Above 10 kW - 1.0 kW

OPTIONAL FEATURES

- Disconnect (toggle or door interlocking)
- P.E. switches
- Magnetic contactors
- Manual reset secondary limit
- Proportional control (SSR)
- 24 volt control transformer
- Airflow switch

MAXIMUM ALLOWABLE KW

UNIT SIZE	MAX CFM	MAX kW
0404	250	3
0504	350	5
0604	400	5
0506	350	5
0606	550	7
0806	700	10
0611	500	7
0811	900	13
1011	900	13
0818	1000	14
1018	1600	22
1218	1800	25
1021	1600	22
1221	2300	30
1421	2300	30
1224	2300	20
1424	2600	25
1230	2300	20
1430	3100	30
1630	3100	30
1440	3100	30
1640	4100	35
1644	4100	40
1844	4600	40



SELECTION PROCEDURE

With standard heater elements, the maximum capacity (kW) is obtained by dividing the heating (fan) SCFM by 70. In other words, the terminal must have at least 70 SCFM per kW. In addition, each size terminal has a maximum allowable kW based upon the specific heater element configuration (i.e. voltage, phase, number of steps, etc.). Contact your ENVIRO-TEC representative or refer to the ENVIRO-TEC web-based computer selection program for design assistance.

Heaters require a minimum of 0.07" w.g. downstream static pressure to ensure proper operation.

For optimum diffuser performance in overhead heating applications, the supply air temperature should be within 20°F of the desired space temperature. This typically requires a higher air capacity which provides higher air motion in the space increasing thermal comfort. The electric heater should be selected with this in mind, keeping the LAT as low as possible.

Selection Equations

$$\text{kW} = \frac{\text{SCFM} \times \Delta T \times 1.085^*}{3413}$$

$$\text{CFM} = \frac{\text{kW} \times 3413}{\Delta T \times 1.085^*}$$

$$\Delta T = \frac{\text{kW} \times 3413}{\text{SCFM} \times 1.085^*}$$

* Air density at sea level - reduce by 0.036 for each 1000 feet of altitude above sea level.

Calculating Line Amperage

$$\text{Single Phase Amps} = \frac{\text{kW} \times 1000}{\text{Volts}}$$

$$\text{Three Phase Amps} = \frac{\text{kW} \times 1000}{\text{Volts} \times 1.73}$$

HOT WATER COIL DATA

MODEL CFR-WC



STANDARD FEATURES

- Coils are designed, manufactured and tested by ENVIRO-TEC
- Aluminum fin construction with die-formed spacer collars for uniform spacing
- Mechanically expanded copper tubes, leak tested to 450 PSIG air pressure and rated at 300 PSIG working pressure at 200°F
- 1, 2, 3 and 4 row configurations
- Male sweat type water connections
- Top and bottom access plate in coil casing for fan sizes 04 through 24. Coil access through bottom casing panel for fan sizes 30, 40 and 44.

OPTIONAL FEATURES

- Steam coils
- Multi-circuit coils for reduced water pressure drop
- Opposite hand water connections

DEFINITION OF TERMS

- EAT** Entering Air Temperature (°F)
- LAT** Leaving Air Temperature (°F)
- EWT** Entering Water Temperature (°F)
- LWT** Leaving Water Temperature (°F)
- CFM** Air Capacity (Cubic Feet per Minute)
- GPM** Water Capacity (Gallons per Minute)
- MBH** 1,000 BTUH
- BTUH** Coil Heating Capacity (British Thermal Units per Hour)
- ΔT** EWT minus EAT

SELECTION PROCEDURE

Hot Water Coil Performance Tables are based upon a temperature difference of 115°F between entering water and entering air. If this ΔT is suitable, proceed directly to the performance tables for selection. All pertinent performance data is tabulated.

ENTERING WATER - AIR TEMPERATURE DIFFERENTIAL (ΔT) CORRECTION FACTORS															
ΔT	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80
FACTOR	0.15	0.19	0.23	0.27	0.31	0.35	0.39	0.43	0.47	0.51	0.55	0.59	0.63	0.67	0.71
ΔT	85	90	95	100	105	110	115	120	125	130	135	140	145	150	155
FACTOR	0.75	0.79	0.83	0.88	0.92	0.96	1.00	1.04	1.08	1.13	1.17	1.21	1.25	1.29	1.33

The table above gives correction factors for various entering ΔT's (difference between entering water and entering air temperatures). Multiply MBH values obtained from selection tables by the appropriate correction factor above to obtain the actual MBH value. Air and water pressure drop can be read directly from the selection table. The leaving air and leaving water temperatures can be calculated from the following fundamental formulas:

$$LAT = EAT + \frac{BTUH}{1.085 \times CFM}$$

$$LWT = EWT - \frac{BTUH}{500 \times GPM}$$

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and hot water coil performance data.

HOT WATER COIL DATA**MODEL CFR-WC UNIT SIZES 0404, 0504, 0604**

AIRFLOW		WATER FLOW			LAT (°F)		LWT (°F)		CAPACITY (MBH)	
Rate (CFM)	Air PD (IN. W.G.)	Rate (GPM)	Water PD (FT. W.G.)		1 Row	2 Row	1 Row	2 Row	1 Row	2 Row
			1 Row	2 Row						
100	1 Row 0.01 2 Row 0.01	0.5	0.3	0.1	115.0	135.7	157.8	148.6	5.4	7.7
		1	1.0	0.3	120.3	144.6	167.7	162.3	6.0	8.6
		2	3.5	1.0	123.5	149.8	173.5	170.6	6.3	9.2
		3	7.5	2.1	124.7	151.7	175.6	173.6	6.5	9.4
		4	12.7	3.5	125.4	152.7	176.6	175.1	6.5	9.5
		5	--	5.3	--	153.3	--	176.1	--	9.6
150	1 Row 0.01 2 Row 0.02	0.5	0.3	0.1	105.7	123.2	152.9	141.4	6.6	9.5
		1	1.0	0.3	111.3	133.3	164.6	157.2	7.5	11.1
		2	3.5	1.0	114.8	139.7	171.7	167.5	8.1	12.1
		3	7.5	2.1	116.1	142.2	174.3	171.4	8.3	12.5
		4	12.7	3.5	116.8	143.4	175.7	173.4	8.4	12.7
		5	--	5.3	--	144.3	--	174.7	--	12.9
200	1 Row 0.02 2 Row 0.04	0.5	0.3	0.1	99.7	114.5	149.2	136.2	7.5	10.7
		1	1.0	0.3	105.2	125.1	162.1	153.3	8.7	13.0
		2	3.5	1.0	108.9	132.2	170.2	165.1	9.5	14.6
		3	7.5	2.1	110.3	135.0	173.3	169.6	9.8	15.2
		4	12.7	3.5	111.0	136.5	174.9	172.0	10.0	15.5
		5	--	5.3	--	137.4	--	173.5	--	15.7
250	1 Row 0.03 2 Row 0.06	0.5	0.3	0.1	95.4	108.2	146.3	132.3	8.2	11.7
		1	1.0	0.3	100.9	118.8	160.1	150.1	9.7	14.6
		2	3.5	1.0	104.5	126.3	169.0	163.0	10.7	16.6
		3	7.5	2.1	106.0	129.3	172.4	168.1	11.1	17.4
		4	12.7	3.5	106.7	130.9	174.2	170.8	11.3	17.8
		5	--	5.3	--	131.9	--	172.5	--	18.1
300	1 Row 0.04 2 Row 0.08	0.5	0.3	0.1	92.2	103.3	143.9	129.2	8.8	12.5
		1	1.0	0.3	97.5	113.8	158.4	147.5	10.6	15.9
		2	3.6	1.0	101.1	121.5	167.9	161.2	11.7	18.4
		3	7.5	2.1	102.6	124.6	171.6	166.7	12.2	19.4
		4	12.7	3.5	103.4	126.3	173.6	169.8	12.5	19.9
		5	--	5.3	--	127.4	--	171.7	--	20.3
350	1 Row 0.05 2 Row 0.11	0.5	0.3	0.1	89.6	99.5	141.9	126.7	9.3	13.1
		1	1.0	0.3	94.8	109.8	156.9	145.3	11.3	17.0
		2	3.6	1.0	98.4	117.5	167.0	159.6	12.7	19.9
		3	7.5	2.1	99.9	120.7	170.9	165.5	13.2	21.1
		4	12.7	3.6	100.7	122.5	173.0	168.8	13.5	21.8
		5	--	5.3	--	123.7	--	170.9	--	22.2
400	1 Row 0.07 2 Row 0.14	0.5	0.3	0.1	87.5	96.4	140.1	124.6	9.7	13.6
		1	1.0	0.3	92.5	106.4	155.5	143.3	11.9	17.9
		2	3.6	1.0	96.1	114.1	166.1	158.2	13.5	21.3
		3	7.5	2.1	97.6	117.4	170.3	164.5	14.1	22.7
		4	12.7	3.6	98.4	119.2	172.6	167.9	14.5	23.5
		5	--	5.3	--	120.4	--	170.1	--	24.0

NOTES:

1. Data is based on 180°F entering water and 65°F entering air temperature at sea level. See selection procedure for other conditions.
2. For optimum diffuser performance in overhead heating applications, the supply air temperature should be within 20°F of the desired space temperature. This typically requires a higher air capacity which provides higher air motion in the space, increasing thermal comfort. The hot water coil should be selected with this in mind, keeping the LAT as low as possible.

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and hot water coil performance data.

HOT WATER COIL DATA

MODEL CFR-WC UNIT SIZES 0606, 0806, 0611, 0811, 1011

AIRFLOW		WATER FLOW			LAT (°F)		LWT (°F)		CAPACITY (MBH)	
Rate (CFM)	Air PD (IN. W.G.)	Rate (GPM)	Water PD (FT. W.G.)		1 Row	2 Row	1 Row	2 Row	1 Row	2 Row
			1 Row	2 Row						
200	1 Row 0.01 2 Row 0.02	0.5	0.4	0.1	107.4	124.1	142.5	127.8	9.2	12.8
		1	1.2	0.4	114.1	136.1	158.2	148.5	10.6	15.4
		2	4.4	1.2	118.4	143.5	168.1	162.5	11.6	17.0
		3	9.2	2.6	120.0	146.3	171.8	167.9	11.9	17.6
		4	15.5	4.4	120.9	147.7	173.8	170.8	12.1	17.9
		5	-	6.6	-	148.6	-	172.6	-	18.1
300	1 Row 0.02 2 Row 0.03	0.5	0.4	0.1	98.5	111.3	135.5	118.7	10.9	15.1
		1	1.2	0.4	105.3	124.0	153.2	140.8	13.1	19.2
		2	4.4	1.2	109.7	132.6	165.1	157.5	14.5	22.0
		3	9.2	2.6	111.5	136.0	169.6	164.2	15.1	23.1
		4	15.5	4.4	112.5	137.8	172.1	167.8	15.4	23.7
		5	-	6.6	-	139.0	-	170.1	-	24.0
400	1 Row 0.03 2 Row 0.06	0.5	0.4	0.1	93.0	103.2	130.5	112.7	12.1	16.5
		1	1.2	0.4	99.5	115.6	149.4	135.2	14.9	21.9
		2	4.4	1.2	104.0	124.8	162.7	153.5	16.9	25.9
		3	9.2	2.6	105.8	128.5	167.9	161.2	17.7	27.5
		4	15.5	4.4	106.8	130.5	170.7	165.4	18.1	28.4
		5	-	6.6	-	131.8	-	168.1	-	28.9
500	1 Row 0.04 2 Row 0.08	0.5	0.4	0.1	89.1	97.5	126.7	108.5	13.1	17.6
		1	1.2	0.4	95.4	109.4	146.4	130.9	16.4	24.0
		2	4.4	1.2	99.8	118.7	160.6	150.2	18.9	29.1
		3	9.2	2.6	101.7	122.6	166.4	158.7	19.9	31.2
		4	15.5	4.4	102.7	124.8	169.5	163.4	20.4	32.4
		5	-	6.6	-	126.2	-	166.4	-	33.1
600	1 Row 0.06 2 Row 0.12	0.5	0.4	0.1	86.2	93.3	123.7	105.3	13.8	18.4
		1	1.2	0.4	92.2	104.6	143.8	127.5	17.7	25.7
		2	4.4	1.2	96.6	113.9	158.9	147.5	20.6	31.8
		3	9.2	2.6	98.5	117.9	165.1	156.5	21.7	34.4
		4	15.5	4.4	99.5	120.2	168.5	161.6	22.4	35.9
		5	-	6.6	-	121.6	-	164.9	-	36.8
700	1 Row 0.08 2 Row 0.15	0.5	0.4	0.1	84.0	90.1	121.2	102.8	14.4	19.0
		1	1.2	0.4	89.7	100.8	141.7	124.7	18.7	27.1
		2	4.4	1.2	94.0	110.0	157.4	145.1	22.0	34.1
		3	9.2	2.6	95.9	114.1	164.0	154.6	23.4	37.2
		4	15.5	4.4	96.9	116.4	167.6	160.0	24.2	38.9
		5	-	6.6	-	117.9	-	163.5	-	40.1
800	1 Row 0.10 2 Row 0.19	0.5	0.4	0.1	82.2	87.5	119.1	100.8	14.9	19.5
		1	1.2	0.4	87.7	97.7	139.8	122.3	19.7	28.3
		2	4.4	1.2	91.9	106.7	156.1	143.1	23.3	36.1
		3	9.2	2.6	93.7	110.8	163.0	152.9	24.9	39.7
		4	15.5	4.4	94.7	113.1	166.8	158.6	25.8	41.7
		5	-	6.6	-	114.6	-	162.3	-	43.0
900	1 Row 0.12 2 Row 0.24	0.5	0.4	0.1	80.8	85.4	117.4	99.1	15.4	19.9
		1	1.2	0.4	86.0	95.1	138.1	120.3	20.5	29.3
		2	4.4	1.2	90.1	103.9	154.9	141.3	24.5	37.9
		3	9.2	2.6	91.9	108.0	162.0	151.4	26.2	41.9
		4	15.5	4.4	92.9	110.3	166.0	157.4	27.2	44.2
		5	-	6.6	-	111.9	-	161.3	-	45.7

NOTES:

1. Data is based on 180°F entering water and 65°F entering air temperature at sea level. See selection procedure for other conditions.
2. For optimum diffuser performance in overhead heating applications, the supply air temperature should be within 20°F of the desired space temperature. This typically requires a higher air capacity which provides higher air motion in the space, increasing thermal comfort. The hot water coil should be selected with this in mind, keeping the LAT as low as possible.

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and hot water coil performance data.

HOT WATER COIL DATA**MODEL CFR-WC UNIT SIZES 0818, 1018, 1218, 1021, 1221, 1421**

AIRFLOW		WATER FLOW			LAT (°F)		LWT (°F)		CAPACITY (MBH)	
Rate (CFM)	Air PD (IN. W.G.)	Rate (GPM)	Water PD (FT. W.G.)		1 Row	2 Row	1 Row	2 Row	1 Row	2 Row
			1 Row	2 Row						
700	1 Row 0.04 2 Row 0.09	0.5	0.4	0.1	86.4	92.7	113.8	94.8	16.3	21.0
		1	1.4	0.4	93.2	105.2	136.3	118.0	21.4	30.5
		2	4.9	1.4	98.4	115.7	154.1	140.7	25.3	38.5
		3	10.3	2.9	100.5	120.4	161.6	151.3	26.9	42.0
		4	17.4	4.9	101.7	122.9	165.7	157.5	27.8	43.9
		5	-	7.4	-	124.6	-	161.5	-	45.2
800	1 Row 0.05 2 Row 0.11	0.5	0.4	0.1	84.4	89.8	111.5	92.6	16.8	21.5
		1	1.4	0.4	91.0	101.7	134.1	115.2	22.5	31.8
		2	4.9	1.4	96.0	112.2	152.5	138.2	26.9	40.9
		3	10.3	2.9	98.2	116.9	160.4	149.3	28.7	44.9
		4	17.4	4.9	99.3	119.5	164.7	155.8	29.8	47.2
		5	-	7.4	-	121.2	-	160.0	-	48.7
1000	1 Row 0.08 2 Row 0.16	0.5	0.4	0.1	81.4	85.6	107.7	89.4	17.8	22.3
		1	1.4	0.4	87.4	96.4	130.4	110.9	24.3	34.0
		2	4.9	1.4	92.3	106.5	149.7	134.1	29.6	44.9
		3	10.3	2.9	94.4	111.2	158.2	145.9	31.9	50.0
		4	17.4	4.9	95.6	113.9	163.0	152.9	33.1	53.0
		5	-	7.4	-	115.7	-	157.5	-	54.9
1200	1 Row 0.11 2 Row 0.23	0.5	0.4	0.1	79.2	82.6	104.8	87.1	18.5	22.9
		1	1.4	0.4	84.8	92.4	127.4	107.5	25.8	35.7
		2	4.9	1.4	89.5	102.1	147.4	130.8	31.9	48.2
		3	10.3	2.9	91.6	106.7	156.4	143.0	34.5	54.2
		4	17.4	4.9	92.7	109.5	161.5	150.4	36.1	57.8
		5	-	7.4	-	111.3	-	155.3	-	60.1
1400	1 Row 0.15 2 Row 0.30	0.5	0.4	0.1	77.6	80.4	102.5	85.3	19.1	23.4
		1	1.4	0.4	82.8	89.4	124.9	104.9	27.0	37.0
		2	4.9	1.4	87.3	98.6	145.4	128.1	33.8	50.9
		3	10.3	2.9	89.3	103.1	154.8	140.6	36.9	57.9
		4	17.4	4.9	90.5	105.9	160.2	148.3	38.6	62.0
		5	-	7.4	-	107.7	-	153.5	-	64.7
1600	1 Row 0.19 2 Row 0.38	0.5	0.4	0.1	76.3	78.7	100.6	83.9	19.5	23.7
		1	1.4	0.4	81.2	87.0	122.9	102.7	28.0	38.0
		2	4.9	1.4	85.5	95.7	143.7	125.7	35.5	53.2
		3	10.3	2.9	87.5	100.2	153.4	138.5	38.9	61.0
		4	17.4	4.9	88.6	102.9	159.0	146.4	40.9	65.7
		5	-	7.4	-	104.7	-	151.8	-	68.8
1800	1 Row 0.23 2 Row 0.47	0.5	0.4	0.1	75.2	77.3	99.0	82.8	19.9	24.0
		1	1.4	0.4	79.8	85.0	121.0	100.9	28.9	38.9
		2	4.9	1.4	84.0	93.3	142.2	123.7	37.0	55.2
		3	10.3	2.9	85.9	97.7	152.2	136.6	40.8	63.7
		4	17.4	4.9	87.0	100.3	158.0	144.8	42.9	68.9
		5	-	7.4	-	102.1	-	150.3	-	72.4
2000	1 Row 0.28 2 Row 0.56	0.5	0.4	0.1	74.4	76.2	97.7	81.9	20.3	24.2
		1	1.4	0.4	78.7	83.3	119.4	99.4	29.7	39.7
		2	4.9	1.4	82.7	91.3	140.8	121.9	38.4	57.0
		3	10.3	2.9	84.6	95.5	151.0	134.9	42.4	66.2
		4	17.4	4.9	85.7	98.2	157.0	143.3	44.8	71.9
		5	-	7.4	-	99.9	-	149.0	-	75.7

NOTES:

1. Data is based on 180°F entering water and 65°F entering air temperature at sea level. See selection procedure for other conditions.
2. For optimum diffuser performance in overhead heating applications, the supply air temperature should be within 20°F of the desired space temperature. This typically requires a higher air capacity which provides higher air motion in the space, increasing thermal comfort. The hot water coil should be selected with this in mind, keeping the LAT as low as possible.

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and hot water coil performance data.

HOT WATER COIL DATA

MODEL CFR-WC UNIT SIZES 1224, 1424

AIRFLOW		WATER FLOW			LAT (°F)		LWT (°F)		CAPACITY (MBH)	
Rate (CFM)	Air PD (IN. W.G.)	Rate (GPM)	Water PD (FT. W.G.)		1 Row	2 Row	1 Row	2 Row	1 Row	2 Row
			1 Row	2 Row						
1000	1 Row 0.03 2 Row 0.06	0.5	0.6	0.2	84.5	88.3	94.4	77.7	21.1	25.3
		1	2.0	0.6	92.7	102.2	118.9	98.1	30.0	40.3
		2	7.1	2.0	99.4	115.5	141.9	124.3	37.3	54.7
		3	14.6	4.2	102.4	121.5	152.4	138.3	40.5	61.2
		4	24.5	7.0	104.0	125.0	158.3	146.8	42.2	65.0
		5	-	10.5	-	127.2	-	152.4	-	67.3
1200	1 Row 0.04 2 Row 0.08	0.5	0.6	0.2	81.8	84.8	91.2	75.6	21.9	25.8
		1	2.0	0.6	89.5	97.5	115.2	94.3	31.8	42.2
		2	7.1	2.0	96.0	110.3	138.8	120.0	40.3	58.9
		3	14.6	4.2	98.9	116.5	149.9	134.5	44.1	66.9
		4	24.5	7.0	100.6	120.0	156.3	143.4	46.3	71.5
		5	-	10.5	-	122.3	-	149.5	-	74.5
1400	1 Row 0.05 2 Row 0.11	0.5	0.6	0.2	79.8	82.2	88.7	74.2	22.5	26.2
		1	2.0	0.6	87.0	93.8	112.1	91.3	33.4	43.7
		2	7.1	2.0	93.3	106.2	136.1	116.5	43.0	62.4
		3	14.6	4.2	96.2	112.3	147.7	131.2	47.3	71.7
		4	24.5	7.0	97.8	115.9	154.5	140.6	49.8	77.2
		5	-	10.5	-	118.3	-	146.9	-	80.8
1600	1 Row 0.07 2 Row 0.13	0.5	0.6	0.2	78.3	80.2	86.7	73.1	23.0	26.4
		1	2.0	0.6	85.0	90.9	109.6	89.0	34.6	44.9
		2	7.1	2.0	91.1	102.7	133.8	113.5	45.2	65.4
		3	14.6	4.2	93.9	108.8	145.8	128.4	50.1	75.9
		4	24.5	7.0	95.6	112.4	152.9	138.0	53.0	82.2
		5	-	10.5	-	114.8	-	144.7	-	86.3
1800	1 Row 0.08 2 Row 0.17	0.5	0.6	0.2	77.0	78.7	85.1	72.2	23.4	26.6
		1	2.0	0.6	83.3	88.5	107.3	87.0	35.7	45.9
		2	7.1	2.0	89.2	99.8	131.8	110.9	47.3	67.9
		3	14.6	4.2	92.0	105.8	144.1	125.9	52.7	79.6
		4	24.5	7.0	93.6	109.4	151.4	135.8	55.8	86.6
		5	-	10.5	-	111.8	-	142.6	-	91.3
2000	1 Row 0.10 2 Row 0.20	0.5	0.6	0.2	76.0	77.4	83.7	71.5	23.8	26.8
		1	2.0	0.6	81.9	86.5	105.4	85.4	36.7	46.7
		2	7.1	2.0	87.7	97.4	129.9	108.7	49.1	70.1
		3	14.6	4.2	90.4	103.2	142.5	123.7	55.0	82.8
		4	24.5	7.0	92.0	106.8	150.1	133.7	58.4	90.6
		5	-	10.5	-	109.3	-	140.8	-	95.9
2200	1 Row 0.12 2 Row 0.24	0.5	0.6	0.2	75.1	76.3	82.6	71.0	24.0	27.0
		1	2.0	0.6	80.8	84.9	103.7	84.1	37.5	47.3
		2	7.1	2.0	86.3	95.2	128.3	106.8	50.7	72.0
		3	14.6	4.2	89.0	101.0	141.1	121.8	57.1	85.7
		4	24.5	7.0	90.5	104.5	148.9	131.9	60.8	94.2
		5	-	10.5	-	107.0	-	139.1	-	100.0
2400	1 Row 0.14 2 Row 0.28	0.5	0.6	0.2	74.3	75.4	81.6	70.5	24.3	27.1
		1	2.0	0.6	79.7	83.4	102.2	82.9	38.3	47.9
		2	7.1	2.0	85.1	93.4	126.8	105.0	52.2	73.8
		3	14.6	4.2	87.7	99.0	139.8	120.0	59.0	88.3
		4	24.5	7.0	89.3	102.5	147.7	130.3	63.1	97.5
		5	-	10.5	-	104.9	-	137.6	-	103.8

NOTES:

1. Data is based on 180°F entering water and 65°F entering air temperature at sea level. See selection procedure for other conditions.
2. For optimum diffuser performance in overhead heating applications, the supply air temperature should be within 20°F of the desired space temperature. This typically requires a higher air capacity which provides higher air motion in the space, increasing thermal comfort. The hot water coil should be selected with this in mind, keeping the LAT as low as possible.

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and hot water coil performance data.

HOT WATER COIL DATA**MODEL CFR-WC UNIT SIZES 1230, 1430, 1630, 1440, 1640**

AIRFLOW		WATER FLOW			LAT (°F)		LWT (°F)		CAPACITY (MBH)	
Rate (CFM)	Air PD (IN. W.G.)	Rate (GPM)	Water PD (FT. W.G.)		1 Row	2 Row	1 Row	2 Row	1 Row	2 Row
1500	1 Row 0.03 2 Row 0.06	0.5	0.7	0.1	80.1	81.8	80.9	69.5	24.5	27.3
		1	2.5	0.7	88.3	94.4	103.2	83.2	37.8	47.8
		2	8.7	2.5	95.9	108.6	128.8	107.9	50.2	70.9
		3	17.9	5.2	99.4	115.9	141.9	123.8	55.9	82.7
		4	29.9	8.6	101.4	120.1	149.7	134.3	59.2	89.6
		5	--	12.8	--	122.9	--	141.5	--	94.2
1700	1 Row 0.04 2 Row 0.08	0.5	0.7	0.1	78.5	79.9	79.2	68.8	24.9	27.5
		1	2.5	0.7	86.2	91.5	100.6	81.1	39.1	48.8
		2	8.7	2.5	93.6	105.2	126.3	104.9	52.6	73.9
		3	17.9	5.2	97.1	112.3	139.8	120.8	59.1	87.2
		4	29.9	8.6	99.1	116.7	147.9	131.5	62.8	95.1
		5	--	12.8	--	119.5	--	139.0	--	100.4
1900	1 Row 0.05 2 Row 0.10	0.5	0.7	0.1	77.3	78.4	77.8	68.3	25.2	27.6
		1	2.5	0.7	84.5	89.1	98.4	79.5	40.2	49.6
		2	8.7	2.5	91.7	102.2	124.1	102.3	54.9	76.5
		3	17.9	5.2	95.1	109.3	137.8	118.1	61.9	91.1
		4	29.9	8.6	97.1	113.6	146.2	129.0	66.1	100.1
		5	--	12.8	--	116.5	--	136.7	--	106.0
2100	1 Row 0.06 2 Row 0.12	0.5	0.7	0.1	76.2	77.2	76.7	67.8	25.5	27.7
		1	2.5	0.7	83.1	87.1	96.5	78.1	41.1	50.3
		2	8.7	2.5	90.0	99.6	122.1	100.0	56.8	78.8
		3	17.9	5.2	93.4	106.6	136.1	115.8	64.5	94.7
		4	29.9	8.6	95.4	110.9	144.7	126.7	69.1	104.5
		5	--	12.8	--	113.9	--	134.6	--	111.1
2300	1 Row 0.07 2 Row 0.14	0.5	0.7	0.1	75.3	76.2	75.7	67.5	25.8	27.8
		1	2.5	0.7	81.8	85.4	94.8	77.0	42.0	50.9
		2	8.7	2.5	88.5	97.4	120.3	98.0	58.6	80.7
		3	17.9	5.2	91.9	104.3	134.5	113.7	66.9	97.8
		4	29.9	8.6	93.8	108.6	143.3	124.7	71.8	108.5
		5	--	12.8	--	111.5	--	132.7	--	115.8
2500	1 Row 0.08 2 Row 0.16	0.5	0.7	0.1	74.6	75.3	74.9	67.2	26.0	27.9
		1	2.5	0.7	80.8	84.0	93.3	76.0	42.7	51.4
		2	8.7	2.5	87.3	95.5	118.6	96.3	60.3	82.5
		3	17.9	5.2	90.5	102.2	133.0	111.8	69.1	100.6
		4	29.9	8.6	92.5	106.4	142.0	122.8	74.4	112.2
		5	--	12.8	--	109.4	--	131.0	--	120.1
2700	1 Row 0.09 2 Row 0.18	0.5	0.7	0.1	73.9	74.6	74.2	67.0	26.1	27.9
		1	2.5	0.7	79.8	82.7	92.0	75.2	43.4	51.8
		2	8.7	2.5	86.1	93.7	117.1	94.8	61.8	84.0
		3	17.9	5.2	89.3	100.3	131.6	110.0	71.1	103.2
		4	29.9	8.6	91.3	104.5	140.8	121.1	76.8	115.5
		5	--	12.8	--	107.4	--	129.4	--	124.1
2900	1 Row 0.10 2 Row 0.21	0.5	0.7	0.1	73.4	73.9	73.6	66.8	26.3	28.0
		1	2.5	0.7	79.0	81.6	90.8	74.5	44.0	52.1
		2	8.7	2.5	85.1	92.2	115.7	93.4	63.1	85.4
		3	17.9	5.2	88.2	98.6	130.3	108.5	73.0	105.5
		4	29.9	8.6	90.2	102.8	139.6	119.6	79.0	118.6
		5	--	12.8	--	105.7	--	127.9	--	127.8
3300	1 Row 0.13 2 Row 0.26	0.5	0.7	0.1	72.4	72.8	72.6	66.5	26.5	28.1
		1	2.6	0.7	77.6	79.7	88.8	73.3	45.0	52.7
		2	8.8	2.5	83.3	89.6	113.3	91.0	65.6	87.8
		3	18.0	5.2	86.4	95.7	128.0	105.7	76.4	109.7
		4	30.1	8.7	88.2	99.7	137.6	116.8	83.1	124.2
		5	--	13.0	--	102.6	--	125.2	--	134.4
3700	1 Row 0.16 2 Row 0.32	0.5	0.7	0.1	71.7	72.0	71.8	66.3	26.7	28.1
		1	2.6	0.7	76.4	78.3	87.1	72.4	45.8	53.2
		2	8.8	2.6	81.9	87.4	111.1	89.0	67.7	89.7
		3	18.1	5.3	84.8	93.2	126.0	103.4	79.5	113.2
		4	30.2	8.8	86.6	97.2	135.7	114.4	86.7	129.0
		5	--	13.0	--	100.0	--	122.8	--	140.2

NOTES:

1. Data is based on 180°F entering water and 65°F entering air temperature at sea level. See selection procedure for other conditions.
2. For optimum diffuser performance in overhead heating applications, the supply air temperature should be within 20°F of the desired space temperature. This typically requires a higher air capacity which provides higher air motion in the space, increasing thermal comfort. The hot water coil should be selected with this in mind, keeping the LAT as low as possible.

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and hot water coil performance data.

HOT WATER COIL DATA

MODEL CFR-WC UNIT SIZES 1644, 1844

AIRFLOW		WATER FLOW			LAT (°F)		LWT (°F)		CAPACITY (MBH)	
Rate (CFM)	Air PD (IN. W.G.)	Rate (GPM)	Water PD (FT. W.G.)		1 Row	2 Row	1 Row	2 Row	1 Row	2 Row
			1 Row	2 Row						
2400	1 Row 0.06 2 Row 0.12	0.5	0.8	0.1	75.1	75.8	74.0	66.8	26.2	28.0
		1	2.7	0.8	81.7	84.9	92.1	75.1	43.4	51.8
		2	9.3	2.7	88.6	97.2	117.5	95.2	61.4	83.6
		3	19.0	5.5	92.1	104.3	132.1	110.8	70.5	102.1
		4	31.8	9.2	94.2	108.8	141.2	122.0	75.9	113.8
		5	--	13.7	--	111.8	--	130.3	--	121.8
2800	1 Row 0.08 2 Row 0.16	0.5	0.8	0.1	73.7	74.3	72.7	66.5	26.5	28.1
		1	2.7	0.8	79.7	82.3	89.4	73.5	44.7	52.6
		2	9.3	2.7	86.3	93.6	114.4	92.0	64.5	86.7
		3	19.1	5.5	89.6	100.4	129.2	107.2	74.7	107.4
		4	31.8	9.2	91.7	104.8	138.7	118.5	80.9	120.8
		5	--	13.7	--	107.9	--	126.9	--	130.1
3200	1 Row 0.10 2 Row 0.21	0.5	0.8	0.1	72.7	73.1	71.7	66.2	26.8	28.1
		1	2.7	0.8	78.2	80.3	87.3	72.4	45.7	53.2
		2	9.3	2.7	84.4	90.7	111.7	89.5	67.1	89.2
		3	19.1	5.6	87.6	97.2	126.7	104.3	78.4	111.8
		4	31.9	9.3	89.6	101.6	136.4	115.5	85.3	126.7
		5	--	13.8	--	104.6	--	124.1	--	137.2
3600	1 Row 0.13 2 Row 0.26	0.5	0.8	0.1	71.9	72.2	70.9	66.0	27.0	28.2
		1	2.7	0.8	77.0	78.8	85.5	71.5	46.6	53.7
		2	9.3	2.7	82.8	88.4	109.5	87.5	69.4	91.3
		3	19.2	5.6	85.9	94.6	124.5	101.8	81.6	115.5
		4	32.0	9.3	87.9	98.8	134.5	112.9	89.2	131.8
		5	--	13.8	--	101.8	--	121.5	--	143.5
4000	1 Row 0.15 2 Row 0.31	0.5	0.8	0.1	71.3	71.5	70.3	65.9	27.1	28.2
		1	2.7	0.8	75.9	77.5	84.0	70.7	47.4	54.0
		2	9.3	2.7	81.5	86.5	107.5	85.8	71.3	93.0
		3	19.2	5.6	84.5	92.4	122.6	99.7	84.5	118.7
		4	32.0	9.3	86.4	96.5	132.7	110.7	92.7	136.3
		5	--	13.8	--	99.4	--	119.3	--	149.0
4400	1 Row 0.18 2 Row 0.37	0.5	0.8	0.1	70.7	70.9	69.8	65.8	27.3	28.3
		1	2.7	0.8	75.1	76.4	82.8	70.2	48.0	54.3
		2	9.3	2.7	80.3	84.8	105.7	84.3	73.1	94.4
		3	19.2	5.6	83.3	90.5	120.9	97.8	87.1	121.5
		4	32.1	9.3	85.1	94.4	131.1	108.7	95.9	140.3
		5	--	13.9	--	97.3	--	117.3	--	153.9
4600	1 Row 0.20 2 Row 0.40	0.5	0.8	0.1	70.5	70.7	69.5	65.7	27.3	28.3
		1	2.7	0.8	74.7	75.9	82.2	69.9	48.3	54.4
		2	9.4	2.7	79.8	84.1	104.9	83.7	73.9	95.1
		3	19.2	5.6	82.7	89.6	120.1	96.9	88.3	122.7
		4	32.1	9.3	84.5	93.5	130.3	107.8	97.4	142.1
		5	--	13.9	--	96.3	--	116.4	--	156.2

NOTES:

1. Data is based on 180°F entering water and 65°F entering air temperature at sea level. See selection procedure for other conditions.
2. For optimum diffuser performance in overhead heating applications, the supply air temperature should be within 20°F of the desired space temperature. This typically requires a higher air capacity which provides higher air motion in the space, increasing thermal comfort. The hot water coil should be selected with this in mind, keeping the LAT as low as possible.

The web-based computer selection program, Web-Select, is available through your ENVIRO-TEC representative for complete CFR selection and hot water coil performance data.

GUIDE SPECIFICATIONS

GENERAL

Furnish and install ENVIRO-TEC Model CFR, or equal, Series Flow Constant Volume Fan Powered Terminals of the sizes and capacities scheduled. Units shall be ETL listed. Terminals with electric heat shall be listed as an assembly. Separate listings for the terminal and electric heater are not acceptable. Terminals shall include a single point electrical connection. Terminal units shall be AHRI certified and bear the AHRI 880 seal.

The entire unit shall be designed and built as a single unit. Field-assembled components or built-up terminals employing components from multiple manufacturers are not acceptable.

CONSTRUCTION

Terminals shall be constructed of not less than 22 gauge galvanized steel, able to with-stand a 125 hour salt spray test per ASTM B-117. Stainless steel casings, or galvanized steel casings with a baked enamel paint finish, may be used as an alternative. The terminal casing shall be mechanically assembled (spot-welded casings are not acceptable).

Casing shall be internally lined with 3/4" thick fiberglass insulation, rated for a maximum air velocity of 5000 f.p.m. Maximum thermal conductivity shall be .24 (BTU • in) / (hr • ft² • °F). Insulation must meet all requirements of ASTM C1071 (including C665), UL 181 for erosion, and carry a 25/50 rating for flame spread/smoke developed per ASTM E-84, UL 723 and NFPA 90A. Raw insulation edges on the discharge of the unit must be covered with metal liner to eliminate flaking of insulation during field duct connections. Simple "buttering" of raw edges with an approved sealant is not acceptable.

Casing shall have full bottom access to gain access to the primary air valve and fan assembly. The opening shall be sufficiently large to allow complete removal of the fan if necessary. The casing shall be constructed in a manner to provide a single rectangular discharge collar. Multiple discharge openings are not acceptable. All appurtenances including control assemblies, control enclosures, hot water heating coils, and electric heating coils shall not extend beyond the top or bottom of the unit casing.

SOUND

The terminal manufacturer shall provide AHRI certified sound power data for radiated and discharge sound.

The sound levels shall not exceed the octave band sound power levels indicated on the schedule. If the sound data does not meet scheduled criteria, the contractor shall be responsible for the provision and installation of any additional equipment or material necessary to achieve the scheduled sound performance.

PRIMARY AIR VALVE

The primary air valve shall consist of a minimum 22 gauge cylindrical body that includes embossment rings for rigidity. The damper blade shall be connected to a solid shaft by means of an integral molded sleeve which does not require screw or bolt fasteners. The shaft shall be manufactured of a low thermal conducting composite material, and include a molded damper position indicator visible from the exterior of the unit. The damper shall pivot in self lubricating bearings. The damper actuator shall be mounted on the exterior of the terminal for ease of service. The valve assembly shall include internal mechanical stops for both full open and closed positions. The damper blade seal shall be secured without use of adhesives. The air valve leakage shall not exceed 1% of maximum inlet rated airflow at 3" W.G. inlet pressure.

PRIMARY AIRFLOW SENSOR

For inlet diameters 6" or greater, the differential pressure airflow sensor shall traverse the duct along two perpendicular diameters. Cylindrically shaped inlets shall utilize the equal cross sectional area or log-linear traverse method. Single axis sensor shall not be acceptable for duct diameters 6" or larger. A minimum of 12 total pressure sensing points shall be utilized. The total pressure inputs shall be averaged using a pressure chamber located at the center of the sensor. A sensor that delivers the differential pressure signal from one end of the sensor is not acceptable. The sensor shall output an amplified differential pressure signal that is at least 2.3 times the equivalent velocity pressure signal obtained from a conventional pitot tube. The sensor shall develop a differential pressure of 0.015" w.g. at an air velocity of < 325 FPM. Documentation shall be submitted which substantiates this requirement. Balancing taps and airflow calibration charts shall be provided for field airflow measurements.

FAN ASSEMBLY

The unit fan shall utilize a forward curved, dynamically balanced, galvanized wheel with a direct drive motor. The motor shall be permanent split capacitor type with

GUIDE SPECIFICATIONS

three separate horsepower taps. Single speed motors with electronic speed controllers are not acceptable. The fan motor shall be unpluggable from the electrical leads at the motor case for simplified removal (open frame motors only). The motor shall utilize permanently lubricated sleeve type bearings, include thermal overload protection and be suitable for use with electronic and/or mechanical fan speed controllers. The motor shall be mounted to the fan housing using torsion isolation mounts properly isolated to minimize vibration transfer.

The terminal shall utilize an electronic (SCR) fan speed controller for aid in balancing the fan capacity. The speed controller shall have a turn down stop to prevent possibility of harming motor bearings.

HOT WATER COIL

Terminal shall include an integral hot water coil where indicated on the plans. The coil shall be manufactured by the terminal unit manufacturer and shall have a minimum 22 gauge galvanized sheet metal casing. Stainless steel casings, or galvanized steel casings with a baked enamel paint finish, may be used as an alternative. Coil to be constructed of pure aluminum fins with full fin collars to assure accurate fin spacing and maximum tube contact. Fins shall be spaced with a minimum of 10 per inch and mechanically fixed to seamless copper tubes for maximum heat transfer.

Each coil shall be hydrostatically tested at a minimum of 450 PSIG under water, and rated for a maximum 300 PSIG working pressure at 200°F. Coils shall incorporate a built in, flush mounted access plate, allowing top and bottom access to coil.

ELECTRIC HEATERS

Terminal shall include an integral electric heater where indicated on the plans. The heater cabinet shall be constructed of not less than 20 gauge galvanized steel. Stainless steel cabinets, or galvanized steel casings with a baked enamel paint finish, may be used as an alternative. Heater shall have a hinged access panel for entry to the controls.

A power disconnect shall be furnished to render the heater non-operational. Heater shall be furnished with all controls necessary for safe operation and full compliance with UL 1995 and National Electric Code requirements.

Heater shall have a single point electrical connection. It shall include a primary disc-type automatic reset high temperature limit, secondary high limit(s), Ni-Chrome

elements, and fusing per UL and NEC. Heater shall have complete wiring diagram with label indicating power requirement and KW output. Heater shall be interlocked with fan terminal so as to preclude operation of the heater when the fan is not running.

OPTIONS

Foil Faced Insulation

Insulation shall be covered with scrim backed foil facing. All insulation edges shall be covered with foil or metal nosing. Insulation shall meet ASTM C1136 and ASTM C665 for mold, mildew and humidity resistance.

Elastomeric Closed Cell Foam Insulation

Provide Elastomeric Closed Cell Foam Insulation in lieu of standard. Insulation shall conform to UL 181 for erosion and NFPA 90A for fire, smoke and melting, and comply with a 25/50 Flame Spread and Smoke Developed Index per ASTM E-84 or UL 723. Additionally, insulation shall comply with Antimicrobial Performance Rating of 0, no observed growth, per ASTM G-21. Polyethylene insulation is not acceptable.

Double Wall Construction

The terminal casing shall be double wall construction using a 22 gauge galvanized metal liner covering all insulation.

Low Temperature Construction

Terminals shall be designed for use with primary airflow temperatures as low as 46°F and maximum ceiling plenum conditions of 78°F and 60% R.H. In addition to other design criteria, the primary air valve shall be thermally isolated from the terminal casing. The damper shaft shall be made from non-conducting thermoplastic composite material. Metal shafts will not be acceptable.

Filters

Terminals shall include a 1" thick disposable fiberglass filter. Filter shall be secured with quick release clips, allowing removal without horizontal sliding.

ECM Fan Motor

Fan motor shall be ECM, "Electronically Commutated Motor" "Genteq Eon." Motor shall be brushless DC controlled by an integral controller / inverter that operates the wound stator and senses rotor position to electronically commutate the stator. Motor shall be permanent magnet type with near-zero rotor losses designed for synchronous rotation. The motor shall utilize permanently lubricated ball bearings. Motor shall maintain minimum 70% efficiency over the entire operating range. Motor speed control shall be accomplished

GUIDE SPECIFICATIONS

through a PWM (pulse width modulation) controller specifically designed for compatibility with the ECM. The speed controller shall have terminals for field verification of fan capacity utilizing a digital volt meter. A calibration graph shall be supplied indicating Fan CFM verses DC Volts.

Piping Packages

Provide a standard factory assembled non-insulated valve piping package to consist of a 2 way, on/off, motorized electric control valve and two ball isolation valves. Control valves are piped normally closed to the coil. Maximum entering water temperature on the control valve shall be 200°F. The maximum close-off pressure is 40 PSIG (1/2") or 20 PSIG (3/4"). Maximum operating pressure shall be 300 PSIG.

Option: Provide 3-wire floating point modulating control valve (fail-in-place) in lieu of standard 2-position control valve with factory assembled valve piping package.

Option: Provide high pressure close-off actuators for 2-way, on/off control valves. Maximum close-off pressure is 50 PSIG (1/2") or 25 PSIG (3/4").

Option: Provide either a fixed or adjustable flow control device for each piping package.

Option: Provide unions and/or pressure-temperature ports for each piping package.

Piping package shall be completely factory assembled, including interconnecting pipe, and shipped separate from the unit for field installation on the coil, so as to minimize the risk of freight damage.

CONTROLS

Analog Electronic Controls

Furnish and install Series 7000 Pressure Independent Analog Electronic Control System where indicated on the plans and in the specifications. The complete system shall be fully operational and include the following:

- Single duct, dual duct, and/or fan powered terminal units
- Pressure independent Series 7000 analog electronic zone controllers with integral differential pressure transducer.
- Analog electronic wall thermostat
- Electronic air valve actuator
- 24 VAC control transformers
- Air pressure switches as required
- Electronic duct temperature sensors as required

Refer to Series 7000 Analog Electronic controls selection guide for detailed guide specifications.

Pneumatic Controls

Units shall be controlled by a pneumatic differential pressure reset volume controller. Controller shall be capable of pressure independent operation down to 0.03 inches W.G. differential pressure and shall be factory set to the specified airflow (CFM). Controller shall not exceed 11.5 scim (Standard Cubic Inches per Minute) air consumption @ 20 PSIG.

Unit primary air valve shall modulate in response to the room mounted thermostat and shall maintain airflow in relation to thermostat pressure regardless of system static pressure changes. An airflow (CFM) curve shall be affixed to the terminal unit expressing differential pressure vs. CFM. Pressure taps shall be provided for field use and ease of balancing.

Terminal unit manufacturer shall supply and manufacture a 5 to 10 PSIG pneumatic actuator capable of a minimum of 45 in. lbs. of torque.

Actual sequence of operation is shown on the contract drawings. Terminal unit manufacturer shall coordinate, where necessary, with the Temperature Control Contractor.

NOTES

NOTES

ENVIRO-TEC is a registered trademark and FlowStar™ is a trademark of Johnson Controls, Inc. in the United States of America and other countries. Other trademarks used herein may be trademarks or registered trademarks of other companies.

Catalog: ET130.13-EG4.1 (418) Supersedes ET130.13-EG4.1 (815)
© 2018 Johnson Controls, Inc. P.O. Box 423, Milwaukee, WI 53201 Printed in USA
www.enviro-tec.com

