


This application provides intermittent fan powered variable air volume control with floating modulating hot water heat, night setback and morning warm up. As space temperature drops, primary airflow is reset from maximum to minimum setpoint. As space temperature continues to drop, the unit fan is energized thus supplying plenum air to the space. On a further drop in space temperature, heat is modulated to satisfy the load. When system air is failed, the unit automatically switches into the night setback mode. The primary air valve remains closed and the unit fan and heat are cycled to maintain the night offset. When warm air is sensed by an electronic duct sensor, the unit fan and heat are deenergized and the primary air valve opens to maximum airflow setpoint for morning warm up. Air volume limits are located at the thermostat.

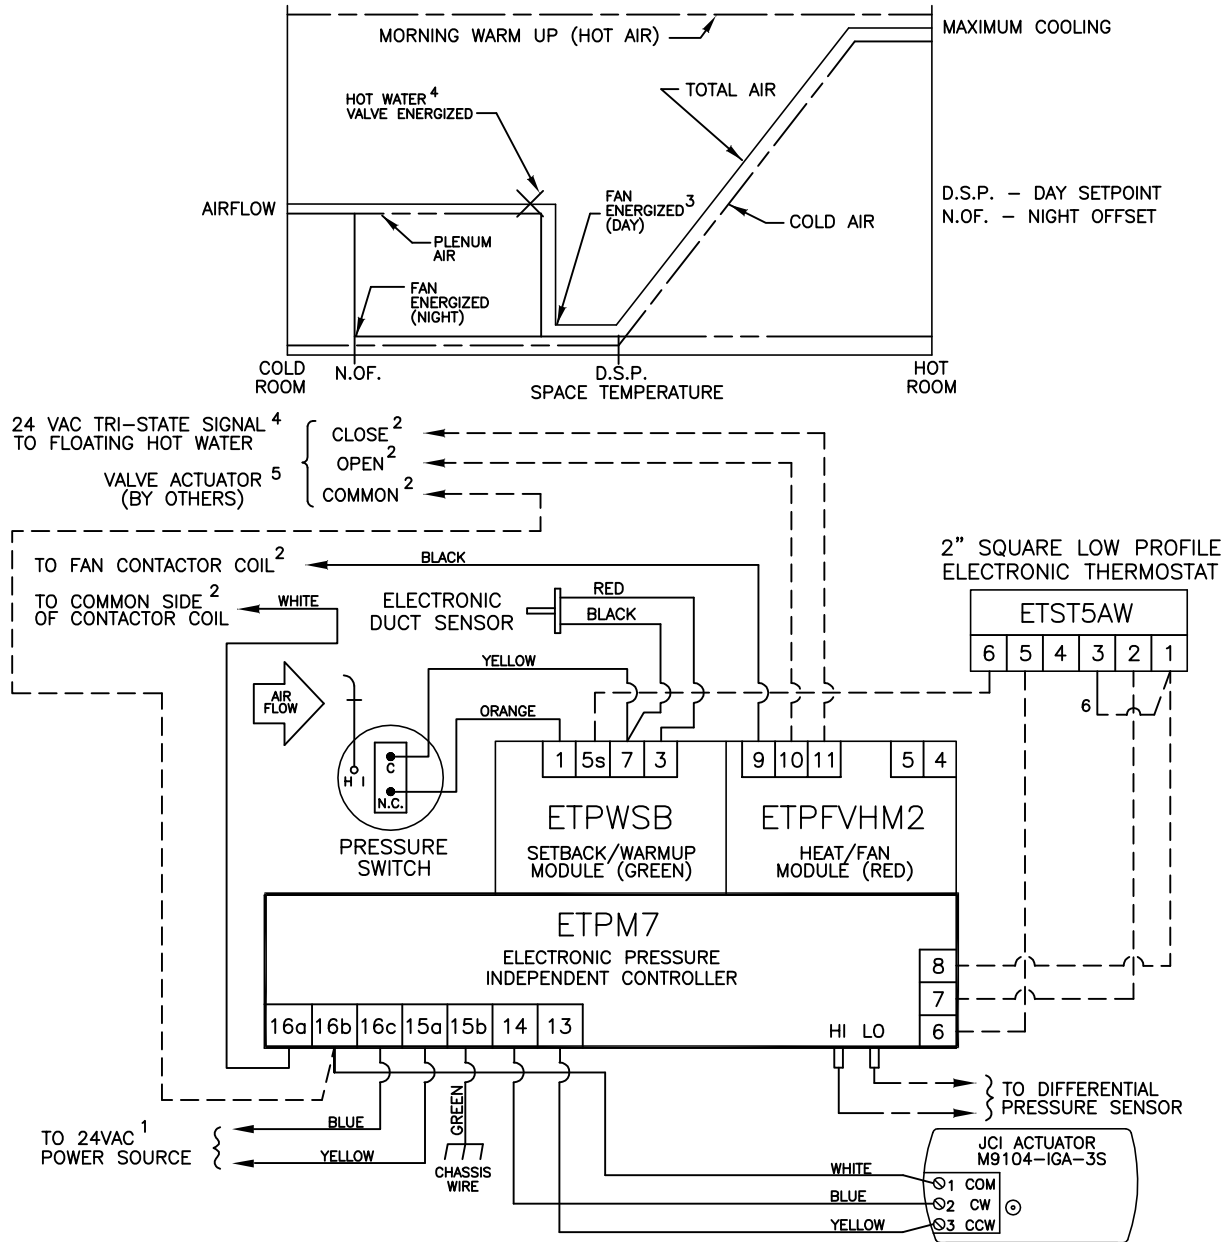

CONTROLLER ASSY. MODEL: ETPX1FTBWDLP

1 MINIMUM 40 VA. UP TO 20 VA AVAILABLE FOR HOT WATER ACTUATOR (BY OTHERS). REFER TO FAN WIRING DIAGRAM FOR TRANSFORMER AND RELAY WIRING, AND OTHER HIGH VOLTAGE WIRING.

2 MAXIMUM 15 VA HOLDING COIL

3 ENERGIZED 1° F BELOW SETPOINT

4 ENERGIZED 2° F BELOW SETPOINT

5 SUPPLIED, MOUNTED AND WIRED BY OTHERS

6 WIRE TERMINAL 3 TO TERMINAL 1 IN THE FIELD

--- FACTORY TUBING
 - - - FIELD WIRING
 ——— FACTORY WIRING

TITLE:

FV7404

PRESSURE INDEPENDENT ELECTRONIC CONTROLS

ENVIRO-TEC
 BY JOHNSON CONTROLS

DRN BY: AWW	DATE: 10/21/97	SCALE: N/A	DRAWING NO.
OKD BY: WAE	DATE: 04/09/08	REV: 09	

19552

THIS DRAWING CONTAINS PROPRIETARY DATA. UNAUTHORIZED DISCLOSURE, REPRODUCTION, OR USE IS STRICTLY PROHIBITED WITHOUT WRITTEN PERMISSION

DO NOT SCALE DRAWING. DIMENSIONS AND DATA ARE SUBJECT TO CHANGE WITHOUT NOTICE. CONTACT FACTORY FOR CERTIFIED DRAWINGS.